


Blue-Book “Lite”

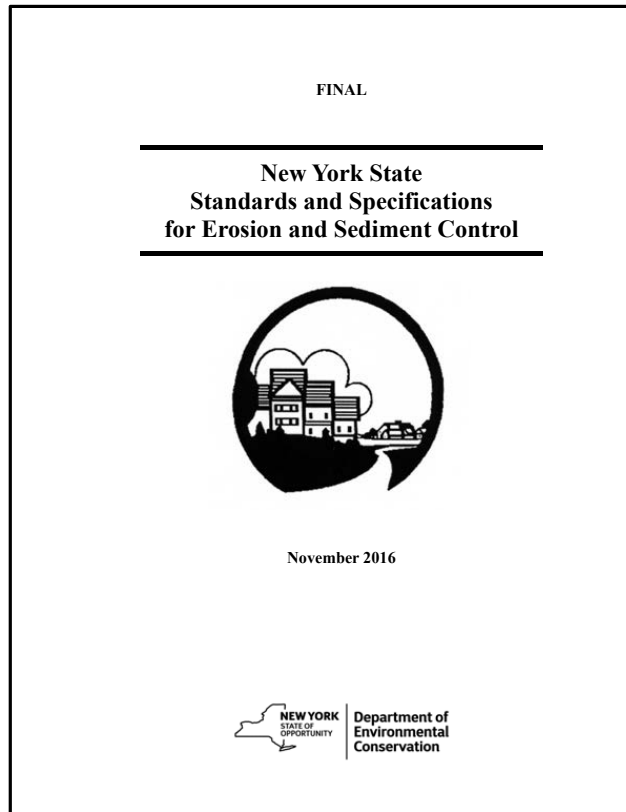

Common Erosion and Sediment Control Standards For Code Municipal Enforcement Officers and Inspectors

For a Complete Copy of the Blue Book, please visit the NYS DEC website at:
<http://www.dec.ny.gov/chemical/29066.html>

New York State Department of Environmental Conservation



Blue Book “Lite”

Table of Contents

The *Blue Book “Lite”* is a compilation of the more commonly used erosion and sediment control practices from the unabridged *New York State Standards and Specifications for Erosion and Sediment Control*, the so-called “Blue Book.” These were compiled for training purposes because construction stormwater site inspectors need to be familiar with the standards and specifications from the “Blue Book,” and these would be more frequently encountered during inspections. The numbers in the Table (left column) represent the pages where the content (right column) would be found in the “Blue Book.” Go to <http://www.dec.ny.gov/chemical/29066.html> to view or download the full document on the New York State Department of Environmental Conservation Website.

1.1 - 1.3	Introduction (first 3 pages, i.e., in the above cited document)
1.4	Basic Principles of Erosion and Sediment Control (first of 2 pages)
2.13 - 2.22	Design Process for Erosion and Sediment Control Plans (10 pages)
2.24	Concrete Truck Washout (1 page)
2.25	Dust Control (1 page)
2.30 & 2.31	Stabilized Construction Access (2 pages)
3.2 & 3.3	Check Dam (2 pages)
3.23 & 3.24 & 3.26	Grassed Waterway (first 2 and fourth of 4 pages)
3.27	Lined Waterway (1 page)
4.22 & 4.23	Fiber Roll (2 pages)
4.39 & 4.40	Mulching (first 2 of 3 pages)
4.42 & 4.43	Permanent Construction Area Plantings (first 2 of 3 pages)
4.54 & 4.55	Stabilization with Sod (2 pages)
5.7 - 5.9	Compost Filter Sock (3 pages)
5.19	Sediment Basin (first of 23 pages)
5.46 - 5.48	Sediment Trap (first 3 of 8 pages)
5.54 & 5.56	Silt Fence (first and third of 3 pages)
5.57 - 5.59	Storm Drain Inlet Protection (first 3 of 6 pages)
5.63 & 5.64	Straw Bale Dike (2 pages)

SECTION 1—INTRODUCTION

Purpose & Scope

The purpose of this document is to provide minimum standards and specifications for meeting criteria set forth by the New York State Department of Environmental Conservation (NYS DEC) for stormwater discharges associated with construction activity. The standards and specifications provide criteria on minimizing erosion and sediment impacts from construction activity involving soil disturbance. They show how to use soil, water, plants, and products to protect the quality of our environment. These standards and specifications were developed in cooperation with the USDA Natural Resources Conservation Service, New York State Soil and Water Conservation Committee (NYSSWCC), NYS DEC and other state and local agencies for use by planners, design engineers, developers, contractors, landscape architects, property owners, and resource managers. Proper use of these standards will protect the waters of the state from sediment loads during runoff events.

Authority

These standards and specifications apply to lands within New York State where housing, industrial, institutional, recreational, or highway construction, and other land disturbances are occurring or imminent. They are statewide in scope and, in some cases, are somewhat generalized due to variations in climate, topography, geology, soils, and plant requirements. Feasible ways to minimize erosion and sedimentation are varied and complex. Following these standards and specifications is presumed to be in compliance with the SPDES general permit for construction activities. Alternative methods may be explored on a case specific basis and shall be discussed with NYS DEC regional staff.

The Environmental Protection Agency delegated stormwater responsibility for the National Pollutant Discharge Elimination System (NPDES) Permit to New York on October 1, 1992. New York State issued its first General Permit for stormwater discharges from construction activities on August 1, 1993. This permit was issued pursuant to Article 17, Titles 7, 8 and Article 70 of Environmental Conservation Law. At a minimum, an erosion and sediment control plan must be prepared for any construction activity that disturbs one or more acres and, in some special watersheds, 5,000 square feet.

Note: Performing activities within or adjacent to wetlands, streams and waterbodies may require permits from the New York State Department of Environmental Conservation (NYSDEC) pursuant to Article 15 (Protection of Waters), Article 24 (Freshwater Wetlands) and Article 25 (Tidal Wetlands) of the Environmental Conservation Law (ECL). Project owners should contact NYSDEC's Regional Division of Environmental Permits early in the site planning process to discuss the requirements for meeting permit issuance standards. Following the New York State Standards and Specifications for Erosion and Sediment Control may not ensure compliance with the above referenced sections of the ECL.

Erosion and Sediment Hazards Associated with Development

Many people may be adversely affected by development on relatively small areas of land. Uncontrolled erosion and sediment from these areas may cause considerable economic damage to individuals and society in general. Stream pollution and damages to public facilities and private homes are examples. Hazards associated with land disturbance include:

1. A large increase of soil exposed to erosion from wind and water;
2. Increased water runoff, soil movement, sediment accumulation and peak flows caused by:
 - a. Removal of plant cover and topsoil;
 - b. A decrease in the area of soil which can absorb water because of construction of streets, buildings, sidewalks, and parking lots;
 - c. Changes in drainage areas caused by grading operations, diversions, and streets;
 - d. Changes in volume and duration of water concentrations caused by altering steepness, distance, and surface roughness;
 - e. Soil compaction by heavy equipment, which can reduce the water intake of soils as much as 90 percent of the original rate; and,
 - f. Prolonged exposure of unprotected sites and disturbed areas to poor weather conditions.
3. Altering the groundwater regime that may adversely affect drainage systems, slope stability, survival of existing vegetation and establishment of new plants;

4. Exposing subsurface materials that are too rocky, too acid, or otherwise unfavorable for establishing plants;
5. Obstructing stream flow with new buildings, dikes, and landfills;
6. Improper timing and sequencing of construction and development activities; and,
7. Abandonment of sites before completion of construction.

How to Use This Book of Standards

This book of standards is organized in a manner to emphasize good planning and environmental site design at the onset of a project, followed by the design process noting the differences with different types of construction operations. Standards are presented in the order of proper site management in the beginning followed by erosion control, using runoff control and soil stabilization, and then sediment control practices.

The standards and specifications listed in this book have been developed over time to reduce the impact of soil loss from construction sites to receiving water bodies and adjacent properties. This book provides designers with details on how to plan a site for erosion and sediment control and how to select, size, and design specific practices to meet these resource protection objectives. The appendices at the end of this book contain additional information as guidance for site plan design and review, construction implementation, and site inspection. Review and inspection checklists are provided to aid planners and designers in meeting the standards requirements.

Section 2. Site Planning, Preparation, and Management

This section discusses the objectives of the erosion and sediment control plan. Site and off-site resources are identified and incorporated into a seven step design process. In addition, special considerations for different types of project development and their needs for erosion and sediment control planning are discussed. Typical site management standards are located in this section.

Section 3. Erosion Control Part 1- Runoff Control

This section provides a number of specific runoff control standards to meet a variety of project needs. Both temporary and permanent practices are presented to manage stormwater runoff to and within the site. The design of some of these practices can be completed by selecting dimensions based on tributary drainage areas; while others require more detailed design analysis

Section 4. Erosion Control Part 2- Soil Stabilization

This section presents detailed standards and specifications for soil stabilization, the second part of erosion control. It includes standards for grading activities, stabilization with seeding and mulching, use of stabilization matting, application of loose stabilization blankets and addresses special applications. Standards for lime and fertilizer application are also included. Bio-technical standards for live fascines, brush mattress and others, are presented for stabilizing steep slopes, road banks, and stream banks. Structural components are also included to aid where vegetative applications alone are inadequate to stabilize an area.

Section 5. Sediment Control

This section addresses the capture, retention and control of sediment within the boundaries of the disturbed construction site. Standards and specifications are included for perimeter controls, storm drain inlet protection, buffer filter strips, temporary sediment traps, tanks, tubes, bags and sediment basins and dewatering devices. A standard for polymer flocculation of dispersive soils is also included in this section.

Appendices

Appendix A. Revised Universal Soil Loss Equation

Soil types at construction sites play a predominant role in how the site should be constructed to control erosion. Knowledge of soil properties, particularly when soils are highly erosive, is essential. This appendix discusses soil properties and provides a method to calculate potential soil loss and provide a measure of reduction depending on slope, area, and protective cover.

Appendix B. Design Process for Erosion & Sediment Control Practices

This appendix demonstrates the design processes for a number of standard practices presented in this book. Specific site examples are used to show step by step procedures to complete detailed designs of the practices, including the appropriate construction specifications, maintenance, and inspection requirements. These processes will allow a designer to evaluate an existing condition or design to a specific level of performance higher than the minimum level presented in these standards.

Appendix C. Cost Analysis of Erosion & Sediment Control Practices

This appendix provides historical bid information for most of the practices contained in the manual. Sources included the NYS Department of Transportation, Monroe County SWCD, national periodicals, and erosion and sediment control cost data from other states. This information will assist a designer in preparing cost estimates for specific

erosion and sediment control plans.

Appendix D. Erosion Control for Small Residential Sites

Within New York State SPDES requirements, many small residential sites have to file for permit coverage. For those sites that require the preparation of a SWPPP which only requires erosion and sediment control plans, this appendix presents example plans for scenarios that can be used by the local authorities and site owners. Attaching the appropriate plan to the building permit assists the owner with compliance with the provisions of the permit.

Appendix E. Sample Checklist for Reviewing Erosion and Sediment Control Plans

This appendix includes a comprehensive checklist for use by all site plan reviewers (including planning board members, conservation board members, conservation district personnel, engineers, consultants, approval authorities, and others) when reviewing erosion and sediment control plans for completeness and proper management.

Appendix F. Construction Site Inspection & Maintenance Site Log Book

A proper site inspection, whether conducted by local authorities or project staff, is necessary to assess the site conditions and the practices implemented. This appendix includes a detailed checklist to assist inspectors in conducting a thorough evaluation of the site when judging the effectiveness of the erosion and sediment control measures.

Appendix G. Tree Species for New York State

This appendix identifies trees suitable for landscape and conservation plantings in New York State.

Appendix H. Glossary

This appendix presents a list of terms commonly used in site planning, design, erosion and sediment control, soil science, construction activities, streambank stabilization and corridor restoration, vegetation, engineering, hydrology and water quality.

Appendix I. Directories

This appendix presents listings of contact information and locations of federal, state, regional and local agencies, who may be involved with environmental and technical review of erosion and sediment control plans. These agencies may also provide data important to the development of stormwater management plans.

BASIC PRINCIPLES OF EROSION AND SEDIMENT CONTROL

The Erosion and Sedimentation Processes

The standards, specifications, and planning procedures presented in this document are intended to be utilized when development activities change the natural topography and vegetative cover of an area. Erosion and sediment control plans must be designed and constructed to minimize erosion and sediment problems associated with soil disturbance. To understand how erosion and sediment rates are increased requires an understanding of the processes themselves.

Soil erosion is the removal of soil by water, wind, ice, or gravity. This document deals primarily with the types of soil erosion caused by rainfall and surface runoff accelerated due to soil disturbance. Raindrops strike the soil surface at a velocity of approximately 25-30 feet per second and can cause splash erosion. Raindrop erosion causes particles of soil to be detached from the soil mass and splash into the air. After the soil particles are dislodged, they can be transported by surface runoff, which results when the soil becomes too saturated to absorb falling rain or when the rain falls at an intensity greater than the rate at which the water can enter the soil. Scouring of the exposed soil surface by runoff can cause further erosion. Runoff can become concentrated into rivulets or well-defined channels up to several inches deep. This advanced stage is called rill erosion. If rills and grooves remain unrepaired, they may develop into gullies when more concentrated runoff flows downslope.

Sediment deposition occurs when the rate of surface flow is insufficient for the transport of soil particles. The heavier particles, such as sand and gravel, transport less readily than the lighter silt and clay particles. Previously deposited sediment may be re-suspended by runoff from another storm and transported farther downslope. In this way, sediment is carried intermittently downstream from its upland point of origin.

Factors That Influence Erosion

The erosion potential of a site is determined by five factors; soil erodibility, vegetative cover, topography, climate, and season. Although the factors are interrelated as determinants of erosion potential, they are discussed separately for easy understanding.

1. **Soil Erodibility** – The vulnerability of a soil to erosion is known as erodibility. The soil structure, texture, and percentage of organic matter influence its erodibility. The most erodible soils generally contain high proportions of silt and very fine sand. The presence of clay (except for dispersive clay) or organic matter, tends to decrease soil erodibility. Clays are sticky and tend to bind soil particles together.

Organic matter helps to maintain stable soil structure (aggregates).

2. **Vegetative Cover** – Vegetation protects soil from the erosive forces of raindrop impact and runoff scour in several ways. Vegetation (top growth) shields the soil surface from raindrop impact while the root mass holds soil particles in place. Grass buffer strips can be used to filter sediment from the surface runoff. Grasses also slow the velocity of runoff, and help maintain the infiltration capacity of a soil. **The establishment and maintenance of vegetation are the most important factors in minimizing erosion during development.**
3. **Topography** – Slope length and steepness greatly influence both the volume and velocity of surface runoff. Long slopes deliver more runoff to the base of slopes and steep slopes increase runoff velocity. Both conditions enhance the potential for erosion to occur.
4. **Climate** – Climate also affects erosion potential in an area. Rainfall characteristics such as frequency, intensity, and duration directly influence the amount of runoff that is generated. As the frequency of rainfall increases, water has less chance to drain through the soil between storms. The soil will remain saturated for longer periods of time and stormwater runoff volume may be potentially greater. Therefore, erosion risks are high where rainfall is frequent, intense, or lengthy.
5. **Season** – Seasonal variation in temperature and rainfall defines periods of high erosion potential during the year. High erosion potential may exist in the spring when the surface soil first thaws and the ground underneath remains frozen. A low intensity rainfall may cause substantial erosion because the frozen subsoil prevents water infiltration. In addition, the erosion potential increases during the summer months due to more frequent, high intensity rainfall.

In summary, these six categories of construction activities highlight some of the variables that should be addressed in ESC plans.



Recognize that every construction project is unique. It may involve a totally new land disturbance or re-configuring and re-developing previous work. It could be located in an urban, suburban or rural area and may involve working with existing impervious areas. Regardless of these circumstances, the erosion and sediment control plan must be prepared to deal with all the potential adverse impacts that could occur to on-site and off-site water resources.

The majority of the standards contained in this book are applicable and adaptable to most of the construction activities previously discussed. However, some of the standards will not be applicable for all activities. The Erosion and Sediment Control Practices Matrix, Table 2.1, indicates which construction activities summarized above, where a particular standard practice is most likely suited for implementation.



Design Process for Erosion and Sediment Control Plans

The design of erosion and sediment control needs to be integrated with the stormwater plan for the project. Since every project is different in its topography, soils, geometry, hydrology, groundwater depths, and intended purpose, it is important to consider all of these attributes as well as post construction stormwater management as ESC plans are developed. A firm knowledge of the New York State Stormwater Management Design Manual criteria and requirements is helpful when integrating green infrastructure planning and practices for runoff reduction such as preservation of natural areas and soil restoration as well as the implementation of standard stormwater treatment practices such as infiltration basins and others. The following design steps detail the process and required elements for developing an ESC plan:

Step 1. Identify existing drainage patterns, drainage area boundaries, and slopes

Current drainage information for the project site, as well as off-site, needs to be obtained and verified through a site visit and survey. Field check drainage patterns, drainage area boundaries, vegetation and land use. Look for existing storm drains, culverts, underground utilities, and other drainage features. Evaluate flow onto, through, and off of the site for existing conditions. Examine the drainage areas to determine the size, slope, slope length, flow path, and, for areas with concentrated flow, the discharge. Decide if off-site flow can be diverted through or around the site. Using ESD principles and green infrastructure techniques, maintain or mimic the existing drainage patterns that give preference to sheet flow and small drainage areas.

Step 2. Identify areas of special concern

Areas of particular environmental concern, such as wetlands, streams, buffers, wooded areas, slopes 15 percent or steeper, and highly erodible and unique soils, need to be identified within both the project site and adjacent areas and shown on the plan. Other considerations include phosphorous impaired watershed areas; National Wetland Inventory; natural heritage areas; rare, threatened, and endangered species habitat; and impaired stream segments with a Total Maximum Daily Load for sediment. Areas of special concern must be verified with a site visit. Note any erosion, lack of vegetation, drainage problems, and other features that may be pertinent to the design. If an unmapped resource is found, contact the appropriate authority to determine additional regulatory requirements.

Step 3. Inventory site and layout development

The initial assessment of the layout needs to be based on the

existing features and proposed construction, minimizing the project's impervious area, acreage of soil disturbance and the encroachment on natural resources in accordance with the green infrastructure planning principles described in chapters 3 and 5 of the New York State Stormwater Management Design Manual and the environmental site design techniques noted earlier in this section. A site program plan has to provide space for the project water, sewer, stormwater facilities, parking, recreation areas and green space. A comprehensive approach to developing the erosion and sediment control and stormwater management plans will minimize changes from the natural hydrology. In addition, expansion of forest, wetland, and stream buffers needs to be considered for enhanced sediment control and improved water quality.

Step 4. Determine phasing requirements and design initial erosion and sediment controls

Depending on the scope of the project, phasing of sediment control and grading may be necessary (e.g., initial, interim, and final phase). Initial controls need to consider existing topography, drainage areas, ground cover, and access throughout the site. If possible, sediment controls installed during the initial phase should be designed to function for all phases of the project. The best designs incorporate careful phasing and sequencing into the overall erosion and sediment control plan and construction strategy. This is often evident in the project's contract construction schedule.

In designing erosion and sediment controls, consider possible locations for staging and stockpile areas and access or haul roads. If staging/stockpile areas are within the project's limit of disturbance, the proposed perimeter controls may suffice. However, if a soil stockpile creates a longer slope length or steeper slope, perimeter controls must be adjusted accordingly. Additionally, an access road may be required down a slope thereby concentrating flow that was previously sheet flow. Considerations must be made for handling this concentrated flow and stabilizing and maintaining the access road. The design and installation of erosion and sediment control practices must not impact areas identified for green infrastructure purposes. For example, compacting soils in areas designated for infiltration, or removing trees or other vegetation identified for stormwater management, is not permissible. However, infiltration basin locations may be used as sediment basins/traps where partial excavation is performed to a minimum limit of 18" above the bottom of the infiltration basin.

Table 2.1 identifies the erosion and sediment control practices contained in this book of standards and lists the primary purpose of each practice along with design criteria and associated practices that might be found used in combination with the listed practice. For example, rock outlet protection, sediment trap, and storm drain inlet are listed as associated practices for the earth dike practice.

Each practice application needs to be evaluated on a case-by-case basis for its associated practices due to the changing characteristics of the project.

The sequencing of a site must take into account the time and access needed to install the initial sediment controls. If earth dikes and a sediment basin are designed as initial controls, these must be completed before beginning other grading. This could require stockpiling the excavated material from the basin rather than using it immediately for fill on the site. Sequencing is also important to ensure that the basin is completed and stabilized prior to the construction of the berms. Additional sediment controls may be required if extensive clearing is needed to reach the proposed basin location.

Step 5. Identify interim drainage patterns, drainage areas, slopes; and design interim controls

Interim conditions are often overlooked yet are important considerations for erosion and sediment control design. Typically, evaluating interim conditions is more difficult than evaluating initial phase or final phase. Project plans always include existing and proposed site conditions. Unlike the initial or final phases, interim conditions are not definitive; they represent the in-between. Due to the shifts in drainage areas and changes in slope and exposure of sub-surface soils, drainage patterns and discharges for an interim phase may be entirely different from initial or final phase, and therefore the erosion and sediment controls may also need to be different. To design interim controls, apply the same procedures used to design initial phase sediment controls. Initial and final phase controls may need to be adjusted or modified to better correlate with the interim phase controls. Depending on the scope of the project, an interim phase erosion and sediment control plan may not be required.

Step 6. Identify proposed drainage patterns, drainage areas, slopes; and design final controls

Follow the same procedures used to design the initial phase erosion and sediment controls. Initial and interim phase controls may need to be adjusted or modified to better correlate with the final phase plans. As construction progresses, consider impacts to staging and stockpile areas and access roads. Also, consideration needs to be given to how the controls implemented for the final phase will be removed.

Step 7. Prepare the Construction Sequence

The sequence of construction describes how the plan will progress. It directs the installation and removal of the different erosion and sediment controls shown on the plan. Sequencing of the project needs to be considered throughout the entire design process. When writing a

sequence of construction, consider whether additional instructions will be helpful to ensure that the controls function as intended. Different types of construction activities will require different sequences for construction. If the disturbed area in any one particular phase of the construction work exceeds 5 acres at any one time, additional control efforts will be required and written acceptance of this plan from the Regional NYSDEC office or MS4 (for projects subject to a traditional land use control MS4) must be received and incorporated in the project documents.

Writing a sequence of construction requires the visualizing and the progression and connection of various site development activities (e.g. clearing, grubbing, grading, utility installation, maintenance of traffic, drainage systems, building systems, stream diversions, erosion and sediment control, stormwater management, etc.) to ensure that the erosion and sediment control practices will be installed and removed at the proper times, and function properly. Depending on the project's complexity, the sequence can be relatively simple or it can involve many small steps. Multiple steps can occur concurrently, while others must be sequential. Large projects that have been segmented into phases should have a separate sequence for each phase. Large projects often follow a prescribed critical path for the construction work. These paths are helpful in developing narratives to explain to contractors and inspectors why a certain erosion and sediment control practice was selected or why following the sequence is imperative to the proper progression of the construction and erosion control effectiveness.

The sequence of construction, at a minimum, must include the following:

- Schedule a pre-construction meeting with appropriate permitting authority
- Delineate resources to protect
- Establish staging area, construction entrance, topsoil stockpile, and concrete truck washout areas
- Protect post-construction practice areas during construction to preserve native soil permeability, install SMP's only after site is stabilized
- Clearing and grubbing as necessary for the installation of perimeter controls
- Establish method of spoils disposal (on-site or off)
- Construction and stabilization of perimeter controls
- Install initial runoff controls and stabilization
- Remaining clearing and grubbing within perimeter
- Road grading
- Grading for the remainder of the site or phase
- Utility installation and connections
- Construction of buildings, roads, and other construction
- Installation of permanent stormwater management measures
- Conduct soil restoration

- Final fine grading, landscaping and stabilization
- Removal of temporary erosion and sediment controls
- Restore and stabilize any disturbed areas remaining upon removal of temporary ESC measures

Most sequences of construction will be more detailed, especially for plans requiring stream diversion, ground water management, or the coordination between the removal of controls in one phase and the installation of different controls in a subsequent phase. If traffic control is a factor, then the erosion and sediment control plan should coordinate with the maintenance of the traffic plan. For subdivision projects, the sequence of construction must identify lots having sediment control practices that preclude the lot from being developed until the contributing drainage area has been final graded and stabilized. Each project is unique and the level of detail in the sequence of construction needs to be tailored to each specific project.

The Erosion and Sediment Control Practices Matrix was prepared as a quick reference for designers and reviewers to obtain major pertinent information about a practice. The matrix is alphabetical and is sectioned by each major control group in this book of standards. Each practice has listed its primary use on the site, the important site characteristics and criteria for application, the type of construction activity where it is best applied, and other associated practices that are often used with it to complement its performance.

The Construction Activity Key, shown below, assigns a number or number and letter to indicate a specific construction activity. Those symbols are listed in the Construction Activity column of the matrix to indicate the applicability of a practice to a particular type of construction. This information is presented as a guide for use and is not to be considered as limiting any particular practice to the activity listed.

Erosion and Sediment Control Practice Matrix Construction Activity Key

1. Linear Projects
 - a. Highway and Road Construction
 - b. Gas and Oil Pipeline, Water Supply Line, and Sanitary Sewer Line Construction
 - c. Wind Farm and Power Line Construction
 - d. Stream Restoration and Streambank Stabilization
 - e. Shoreline Stabilization
 - f. Flood Dike Systems
2. Residential Projects
 - a. Small scale
 - b. Large scale
3. Commercial/Industrial Development Projects
 - a. Small scale
 - b. Large scale
4. Institutional Construction Projects
5. Water Resource Projects
6. Large Overlot Grading Projects

Table 2.1
Erosion and Sediment Control Practices Matrix
Site Planning, Preparation and Management

Practice	Primary Purpose	Site Characteristics	Construction Activity*	Associated Practices
Concrete Truck Washout	Collect Waste	Concrete construction	All	Stabilized Access
Construction Road Stabilization	Control sediment	All construction routes	All	Dust control, temporary swales, temporary or permanent seeding
Dust Control	Stabilize soil	Access points, construction roads	1a,1b,2,3,4,6	Stabilized construction access, construction road stabilization
Protecting Vegetation During Construction	Preserve existing vegetation	Site specific	All	Recreational area improvement
Site Pollution Prevention	Manage waste	Site logistics	All	Those in this section
Stabilized Construction Access	Control sediment	Access points	All	Filter fence, construction road stabilization
Temporary Access Waterway Crossing	Prevent sediment	Streams and banks	All	Construction road stabilization, streambank protection
Winter Stabilization	Soil stabilization	Disturbed areas	All	Seeding, mulching, buffer strips
* See Erosion and Sediment Control Practice Matrix Construction Activity Key on page 2.15				

Table 2.2
Erosion and Sediment Control Practices Matrix
Erosion Control Part 1 - Runoff Control (See Section 3)

<u>Practice</u>	<u>Primary Purpose</u>	<u>Site Characteristics</u>	<u>Construction Activity</u>	<u>Associated Practices</u>
Check Dam	Control runoff	Drainage area \leq 2 Ac.	All	Lined waterway, rock outlet protection
Construction Ditch	Divert runoff	Drainage area \leq 10 Ac.	All	Sediment traps, storm drain inlet protection, sediment basin, level spreader
Dewatering Sump Pit	Control sediment	Site specific	All	Sediment trap, sediment basin
Diversion	Intercept and divert runoff	Minimum 10 year design Q	1a,2b,3b,4,5,6	Permanent seeding, rock outlet protection, flow spreader, sediment basin
Earth Dike	Control runoff	Drainage area \leq 10 ac.	1a,1b,1c,2,3,4,5,6,	Sediment trap, rock outlet protection, sediment basin
Flow Diffuser	Control runoff	Minimum design Q = 10 yr. 24 hr.	1a,1b,1c,5,6	Seeding, sodding, land grading, diversion
Flow Spreader	Control runoff	Minimum design Q = 10 yr. 24 hr.	1a,1b,1c,5,6	Diversion, grassed waterway, construction ditch
Grade Stabilization Structure	Prevent erosion	Minimum design Q = 10 yr. 24 hr.	1d,1e,5,6	Permanent seeding, rock slope protection, structural stream-bank protection
Grassed Waterway	Convey runoff	Minimum 10 year design Q	2a,3b,5,6	Rock outlet protection, vegetated waterways, sediment basin, flow spreader
Lined Waterway (rock materials)	Convey runoff	Minimum design Q = 10 yr. 24 hr.	1a-c,2,3,4,5,6	Rock outlet protection, subsurface drain
Paved Flume	Convey runoff	Minimum design Q = 10 yr. 24 hr.	1a,3,4,6	Rock outlet protection
Perimeter Dike/Swale	Divert runoff	Drainage area \leq 5 Ac.	1a-c,2a,3a,5,6	Sediment trap, flow spreader, check dam, temporary seeding
Pipe Slope Drain	Convey runoff down slope	Drainage area \leq 3.5 Ac.	1a,1d,5,6	Rock outlet protection
Rock Outlet Protection	Prevent erosion	Rock varies with pipe discharge	All	Diversion, grassed waterway, sediment basin, sediment traps
Storm Drain Diversion	Divert runoff	On-site drainage area > 50% total drainage area	1a,2,3,4,6	Sediment trap/basin
Subsurface Drain	Intercept and convey drainage water	1" Drainage Coefficient	1a,2,3,4,6	Rock outlet protection, land grading, retaining wall
Water Bars	Divert runoff	Slope areas < 100 ft. width	1b,1c,5	Rock outlet protection, flow spreader
* See Erosion and Sediment Control Practice Matrix Construction Activity Key on page 2.15				

Table 2.3
Erosion and Sediment Control Practices Matrix
Erosion Control Part 2 - Soil Stabilization (See Section 4)

<u>Practice</u>	<u>Primary Purpose</u>	<u>Site Characteristics</u>	<u>Construction Activity</u>	<u>Associated Practices</u>
Anchored Stabilization Matting	Stabilize soil	Site specific	All, steep slopes	Seeding, topsoiling
Armored Slope and Channel Stabilization	Prevent erosion	Minimum design Q= 10 yr. 24 hr., velocity > 6 feet per second	1d,1e,1f	Live facines, live stakes, retaining walls
Branch Packing	Stabilize soil	Maximum 1.5:1 slopes	1d,5,6	Diversion, subsurface drain, temporary swale
Brush Layer	Stabilize soil	Site specific slopes	1d,1e,3,4,5,6	Rock slope protection, armored streambank protection
Brush Mattress	Stabilize soil	Stream bank slopes	1a, 6	Rock slope protection
Establishing Trees, Shrubs, and Vines	Stabilize soil	Site specific	All	Topsoiling, seeding, fertilizer application
Fertilizer Application	Promote seeding	Site specific	All	Seeding, mulching, topsoiling, land grading
Fiber Roll	Provide growth medium	Site specific	1d,1e,5	Live facines, live stakes
Land Grading	Stabilize soil	Site specific shaping	All	Topsoiling, subsurface drain, seeding
Lime Application	Stabilize soil	Site specific	All	Topsoiling, seeding
Live Crib Wall	Stabilize soil	Site specific	All	Retaining walls
Live Fascines	Stabilize soil	Max. 1.5:1 slope	1a,1d,1e,5,6	Diversion, seeding
Live Stakes	Stabilize soil	Site specific	1d,1e,4,5,6	Armored streambank protection, fiber roll
Loose Stabilization Blankets	Stabilize soil	Site Specific	All	Permanent and temporary seeding, Recreation area
Mulching	Stabilize soil	Site specific	All	Permanent and temporary seeding, Recreation area
Permanent Seeding for Construction Areas	Stabilize soil	Site specific	All	Surface roughening, topsoiling, sodding
Recreation Area Seeding	Protect areas/soils	Site specific	All	Permanent seeding, mulching, topsoiling
Retaining Walls	Stabilize soil	Site specific constraints	1a,2,3,4,6	Rock slope protection, permanent seeding, subsurface drain
* See Erosion and Sediment Control Practice Matrix Construction Activity Key on page 2.15				

Table 2.3 (Continued)
Erosion and Sediment Control Practices Matrix
Erosion Control Part 2 - Soil Stabilization (See Section 4)

<u>Practice</u>	<u>Primary Purpose</u>	<u>Site Characteristics</u>	<u>Construction Activity</u>	<u>Associated Practices</u>
Soil Restoration	Stabilize soil, promote infiltration	Compacted areas	All	Topsoiling, seeding
Stabilization of Sand and Gravel Pits	Stabilize soil	Site specific	1a,1c,3,4,5,6	Topsoiling, seeding
Stabilization With Sod	Stabilize soil	Need quick cover, aesthetics	2,3,4	Inlet protection, top soiling, permanent seeding
Surface Roughening	Stabilize soil	Construction slopes	All	Temporary seeding, permanent seeding, mulching
Temporary Seeding for Construction Areas	Stabilize soil	Site specific	All	Surface roughening, top soiling, sodding
Topsoiling and Amendments	Enhance growing conditions	Poor site soil characteristics	All	Surface roughening, temporary seeding, permanent seeding
Tree Revetment	Stabilize soil	Site specific	1d,1e	Armored streambank protection
Vegetated Gabions	Stabilize soil	Site specific	1a-e,2,3,4,5,6	Live cribwall, retaining wall
Vegetating Sand Dunes and Tidal Banks	Stabilize sand dunes	Sand dune reinforcement	1e, 2,3,4,5,6	Sediment trap, rock outlet, storm drain inlet protection
Vegetating Waterways	Stabilize soil	Site specific	2a,3b,5,6	Grassed waterways, permanent seeding
* See Erosion and Sediment Control Practice Matrix Construction Activity Key on page 2.15				

Table 2.4
Erosion and Sediment Control Practices Matrix
Sediment Control (See Section 5)

<u>Practice</u>	<u>Primary Purpose</u>	<u>Site Characteristics</u>	<u>Construction Activity</u>	<u>Associated Practices</u>
Buffer Filter Strip	Filter sediment	Turbid sheet flow	All	Storm drain inlets, water conveyances
Compost Filter Sock	Filter sediment	Turbid sheet flow	All	Storm drain inlets, water conveyances
Dewatering Device	Discharge clean water	Turbidity in sediment basin	All	Sediment basins, sediment traps
Geotextile Filter Bag	Filter sediment	Small areas, pumped	All	Subsurface drain, dewatering sump pit, buffer filter strip
Portable Sediment Tank	Retain sediment	16 times pump discharge	2a,3a,4	Sediment trap, sediment basin
Rock Dam	Trap sediment	Drainage area \leq 50 Ac.	1a,1b,1c,2b3b,4,5,6	Rock outlet protection
Sediment Basin	Capture sediment	Drainage area \leq 50 Ac.	1a,2b,3b,4,5,6	Rock outlet protection, temporary seeding
Sediment Dike	Capture sediment	Small disturbed areas	2a,2b,3a	Buffer filter strip, filter bag
Sediment Trap - Compost Sock	Trap sediment	Drainage area \leq 5 Ac.	All	Seeding, sodding
Sediment Trap - Pipe Outlet	Trap sediment	Drainage area \leq 5 Ac.	All	Sediment basin, rock outlet protection
Sediment Trap - Stone Outlet	Trap sediment	Drainage area \leq 5 Ac.	All	Rock outlet protection
Silt Fence	Control sediment	2:1 slopes maximum, 50 ft. spacing	All	Straw bale dike
Storm Drain Inlet Protection - Excavated	Trap sediment	Drainage area \leq 1 Ac.	1a,2,3,4,6	Sediment traps, storm drain diversion
Storm Drain Inlet Protection - Fabric	Trap sediment	Drainage area \leq 1 Ac.	1a,2,3,4,6	Sediment traps, storm drain diversion
Storm Drain Inlet Protection - Inserts	Trap sediment	Drainage area \leq 1 Ac.	1a,2,3,4,6	Sediment traps, storm drain diversion
Storm Drain Inlet Protection - Paved Surface	Trap sediment	Drainage area \leq 1 Ac.	1a	Sediment traps, storm drain diversion
Storm Drain Inlet Protection - Stone and Block	Trap sediment	Drainage area \leq 1 Ac.	2,3,4,6	Sediment traps, storm drain diversion
Straw Bale Dike	Control sediment	2:1 slopes maximum, 25 ft. spacing	All	Silt fence
* See Erosion and Sediment Control Practice Matrix Construction Activity Key on page 2.15				

Table 2.4 (Continued)
Erosion and Sediment Control Practices Matrix
Sediment Control (See Section 5)

<u>Practice</u>	<u>Primary Purpose</u>	<u>Site Characteristics</u>	<u>Construction Activity</u>	<u>Associated Practices</u>
Turbidity Curtain	Control sediment	Calm water	1b,1d,1e,1f,5	Sediment traps, basins, seeding, mulching
Water structures/barriers	Control sediment	Large area for placement	1d,1e,1f,5	Armored streambank protection, retaining walls
* See Erosion and Sediment Control Practice Matrix Construction Activity Key on page 2.15				

Table 2.5
Erosion Risk

Soil Type and Parameters	<u>Slope %</u>		
	0-5	5-15	>15
Gravelly, $K < 0.35$ Non-cohesive PI= NP, Fines: 0-10%	Low	Low	Med
Sandy, $K > 0.35$ PI= NP, Fines: 0-30%	Med	High	High
Silty, $K > 0.35$ PI= NP, Fines: 50+%	Med	High	Very High
Clay, $K < 0.35$ Cohesive PI=7+, Fines: 50+%	Low	Med	High
Dispersive Clay Soils	High	Very High	Extreme
<p>Note: Erosion risk is the probability that the combination of parameters presented will generate a significant amount of soil loss. There are other factors that contribute to erosion, such as slope length and rainfall intensity and duration. Also, even though there may be low erosion risk, there can be a high risk to water quality when the soil disturbance is close to water resources. Each site needs to be evaluated on its own merit to determine actual soil loss. Methodology for this analysis is presented in Appendix A.</p>			

STANDARD AND SPECIFICATIONS FOR CONCRETE TRUCK WASHOUT



Definition & Scope

A temporary excavated or above ground lined constructed pit where concrete truck mixers and equipment can be washed after their loads have been discharged, to prevent highly alkaline runoff from entering storm drainage systems or leaching into soil.

Conditions Where Practice Applies

Washout facilities shall be provided for every project where concrete will be poured or otherwise formed on the site. This facility will receive highly alkaline wash water from the cleaning of chutes, mixers, hoppers, vibrators, placing equipment, trowels, and screeds. Under no circumstances will wash water from these operations be allowed to infiltrate into the soil or enter surface waters.

Design Criteria

Capacity: The washout facility should be sized to contain solids, wash water, and rainfall and sized to allow for the evaporation of the wash water and rainfall. Wash water shall be estimated at 7 gallons per chute and 50 gallons per hopper of the concrete pump truck and/or discharging drum. The minimum size shall be 8 feet by 8 feet at the bottom and 2 feet deep. If excavated, the side slopes shall be 2 horizontal to 1 vertical.

Location: Locate the facility a minimum of 100 feet from drainage swales, storm drain inlets, wetlands, streams and other surface waters. Prevent surface water from entering the structure except for the access road. Provide appropriate access with a gravel access road sloped down to the structure. Signs shall be placed to direct drivers to the facility after their load is discharged.

Liner: All washout facilities will be lined to prevent

leaching of liquids into the ground. The liner shall be plastic sheeting with a minimum thickness of 10 mils with no holes or tears, and anchored beyond the top of the pit with an earthen berm, sand bags, stone, or other structural appurtenance except at the access point.

If pre-fabricated washouts are used they must ensure the capture and containment of the concrete wash and be sized based on the expected frequency of concrete pours. They shall be sited as noted in the location criteria.

Maintenance

- All concrete washout facilities shall be inspected daily. Damaged or leaking facilities shall be deactivated and repaired or replaced immediately. Excess rainwater that has accumulated over hardened concrete should be pumped to a stabilized area, such as a grass filter strip.
- Accumulated hardened material shall be removed when 75% of the storage capacity of the structure is filled. Any excess wash water shall be pumped into a containment vessel and properly disposed of off site.
- Dispose of the hardened material off-site in a construction/demolition landfill. On-site disposal may be allowed if this has been approved and accepted as part of the projects SWPPP. In that case, the material should be recycled as specified, or buried and covered with a minimum of 2 feet of clean compacted earthfill that is permanently stabilized to prevent erosion.
- The plastic liner shall be replaced with each cleaning of the washout facility.
- Inspect the project site frequently to ensure that no concrete discharges are taking place in non-designated areas.

STANDARD AND SPECIFICATIONS FOR DUST CONTROL



dust control (see Section 3).

Mulch (including gravel mulch) – Mulch offers a fast effective means of controlling dust. This can also include rolled erosion control blankets.

Spray adhesives – These are products generally composed of polymers in a liquid or solid form that are mixed with water to form an emulsion that is sprayed on the soil surface with typical hydroseeding equipment. The mixing ratios and application rates will be in accordance with the manufacturer's recommendations for the specific soils on the site. In no case should the application of these adhesives be made on wet soils or if there is a probability of precipitation within 48 hours of its proposed use. Material Safety Data Sheets will be provided to all applicators and others working with the material.

Definition & Scope

The control of dust resulting from land-disturbing activities, to prevent surface and air movement of dust from disturbed soil surfaces that may cause off-site damage, health hazards, and traffic safety problems.

Conditions Where Practice Applies

On construction roads, access points, and other disturbed areas subject to surface dust movement and dust blowing where off-site damage may occur if dust is not controlled.

Design Criteria

Construction operations should be scheduled to minimize the amount of area disturbed at one time. Buffer areas of vegetation should be left where practical. Temporary or permanent stabilization measures shall be installed. No specific design criteria is given; see construction specifications below for common methods of dust control.

Water quality must be considered when materials are selected for dust control. Where there is a potential for the material to wash off to a stream, ingredient information must be provided to the NYSDEC.

No polymer application shall take place without written approval from the NYSDEC.

Construction Specifications

A. Non-driving Areas – These areas use products and materials applied or placed on soil surfaces to prevent airborne migration of soil particles.

Vegetative Cover – For disturbed areas not subject to traffic, vegetation provides the most practical method of

B. Driving Areas – These areas utilize water, polymer emulsions, and barriers to prevent dust movement from the traffic surface into the air.

Sprinkling – The site may be sprayed with water until the surface is wet. This is especially effective on haul roads and access route to provide short term limited dust control.

Polymer Additives – These polymers are mixed with water and applied to the driving surface by a water truck with a gravity feed drip bar, spray bar or automated distributor truck. The mixing ratios and application rates will be in accordance with the manufacturer's recommendations. Incorporation of the emulsion into the soil will be done to the appropriate depth based on expected traffic. Compaction after incorporation will be by vibratory roller to a minimum of 95%. The prepared surface shall be moist and no application of the polymer will be made if there is a probability of precipitation within 48 hours of its proposed use. Material Safety Data Sheets will be provided to all applicators working with the material.

Barriers – Woven geo-textiles can be placed on the driving surface to effectively reduce dust throw and particle migration on haul roads. Stone can also be used for construction roads for effective dust control.

Windbreak – A silt fence or similar barrier can control air currents at intervals equal to ten times the barrier height. Preserve existing wind barrier vegetation as much as practical.

Maintenance

Maintain dust control measures through dry weather periods until all disturbed areas are stabilized.

STANDARD AND SPECIFICATIONS FOR STABILIZED CONSTRUCTION ACCESS



Definition & Scope

A stabilized pad of aggregate underlain with geotextile located at any point where traffic will be entering or leaving a construction site to or from a public right-of-way, street, alley, sidewalk, or parking area. The purpose of stabilized construction access is to reduce or eliminate the tracking of sediment onto public rights-of-way or streets.

Conditions Where Practice Applies

A stabilized construction access shall be used at all points of construction ingress and egress.

Design Criteria

See Figure 2.1 on page 2.31 for details.

Aggregate Size: Use a matrix of 1-4 inch stone, or reclaimed or recycled concrete equivalent.

Thickness: Not less than six (6) inches.

Width: 12-foot minimum but not less than the full width of points where ingress or egress occurs. 24-foot minimum if there is only one access to the site.

Length: As required, but not less than 50 feet (except on a single residence lot where a 30 foot minimum would apply).

Geotextile: To be placed over the entire area to be covered with aggregate. Filter cloth will not be required on a single-family residence lot. Piping of surface water under entrance shall be provided as required. If piping is impossible, a mountable berm with 5:1 slopes will be permitted.

Criteria for Geotextile: The geotextile shall be woven or nonwoven fabric consisting only of continuous chain polymeric filaments or yarns of polyester. The fabric shall be

inert to commonly encountered chemicals, hydro-carbons, mildew, rot resistant, and conform to the fabric properties as shown:


Fabric Properties ³	Light Duty ¹ Roads Grade Sub-grade	Heavy Duty ² Haul Roads Rough Graded	Test Method
Grab Tensile Strength (lbs)	200	220	ASTM D1682
Elongation at Failure (%)	50	60	ASTM D1682
Mullen Burst Strength (lbs)	190	430	ASTM D3786
Puncture Strength (lbs)	40	125	ASTM D751 Modified
Equivalent	40-80	40-80	US Std Sieve
Opening Size			CW-02215
Aggregate Depth	6	10	-
¹ Light Duty Road: Area sites that have been graded to subgrade and where most travel would be single axle vehicles and an occasional multi-axle truck. Acceptable materials are Trevira Spunbond 1115, Mirafi 100X, Typar 3401, or equivalent. ² Heavy Duty Road: Area sites with only rough grading, and where most travel would be multi-axle vehicles. Acceptable materials are Trevira Spunbond 1135, Mirafi 600X, or equivalent. ³ Fabrics not meeting these specifications may be used only when design procedure and supporting documentation are supplied to determine aggregate depth and fabric strength.			

Maintenance

The access shall be maintained in a condition which will prevent tracking of sediment onto public rights-of-way or streets. This may require periodic top dressing with additional aggregate. All sediment spilled, dropped, or washed onto public rights-of-way must be removed immediately.

When necessary, wheels must be cleaned to remove sediment prior to entrance onto public rights-of-way. When washing is required, it shall be done on an area stabilized with aggregate, which drains into an approved sediment-trapping device. All sediment shall be prevented from entering storm drains, ditches, or watercourses.

Figure 2.1
Stabilized Construction Access

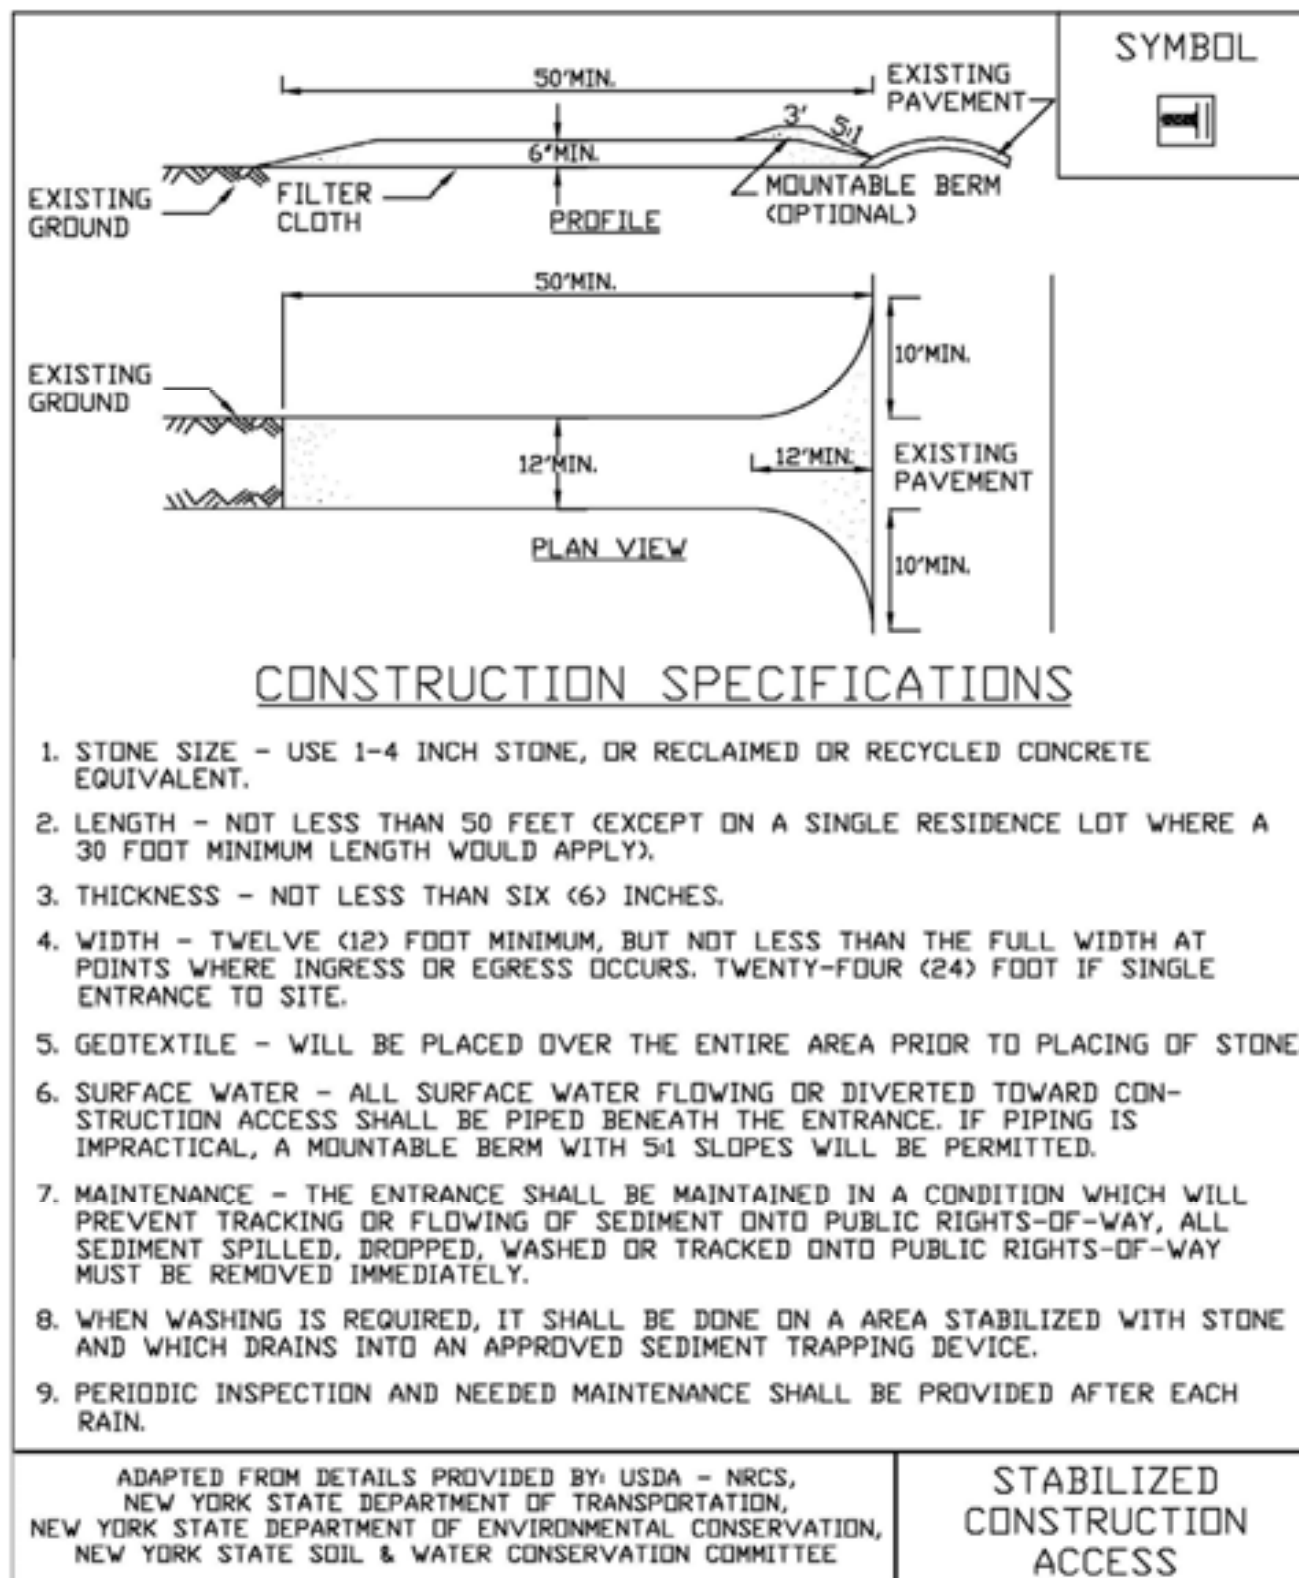

STANDARD AND SPECIFICATIONS FOR CHECK DAM



Definition & Scope

Small barriers or dams constructed of stone, bagged sand or gravel, or other durable materials across a drainageway to reduce erosion in a drainage channel by reducing the velocity of flow in the channel.

Conditions Where Practice Applies

This practice is used as a **temporary** and, in some cases, a **permanent** measure to limit erosion by reducing velocities in open channels that are degrading or subject to erosion or where permanent stabilization is impractical due to short period of usefulness and time constraints of construction.

Design Criteria

Drainage Area: Maximum drainage area above the check dam shall not exceed two (2) acres.

Height: Not greater than 2 feet. Center shall be maintained 9 inches lower than abutments at natural ground elevation.

Side Slopes: Shall be 2:1 or flatter.

Spacing: The check dams shall be spaced as necessary in the channel so that the crest of the downstream dam is at the elevation of the toe of the upstream dam. This spacing is equal to the height of the check dam divided by the channel slope.

Therefore:

$$S = \frac{h}{s}$$

Where:

S = spacing interval (ft.)
h = height of check dam (ft.)
s = channel slope (ft./ft.)

Example:

For a channel with
and 2 ft. high stone
they are spaced as

$$S = \frac{2 \text{ ft}}{0.04 \frac{\text{ft}}{\text{ft}}} = 50 \text{ ft}$$

a 4% slope
check dams,
follows:

For stone check dams: Use a well graded stone matrix 2 to 9 inches in size (NYS – DOT Light Stone Fill meets these requirements).

The overflow of the check dams will be stabilized to resist erosion that might be caused by the check dam. See Figure 3.1 on page 3.3 for details.

Check dams should be anchored in the channel by a cutoff trench 1.5 ft. wide and 0.5 ft. deep and lined with filter fabric to prevent soil migration.


For filter sock or fiber roll check dams: The check dams will be anchored by staking the dam to the earth contact surface. The dam will extend to the top of the bank. The check dam will have a splash apron of NYS DOT #2 crushed stone extending a minimum 3 feet downstream from the dam and 1 foot up the sides of the channel. The compost and materials for a filter sock check dam shall meet the requirements shown in the standard for Compost Filter Sock on page 5.7.

Maintenance

The check dams should be inspected after each runoff event. Correct all damage immediately. If significant erosion has occurred between structures, a liner of stone or other suitable material should be installed in that portion of the channel or additional check dams added.

Remove sediment accumulated behind the dam as needed to allow channel to drain through the stone check dam and prevent large flows from carrying sediment over the dam.

Figure 3.1
Stone Check Dam Detail

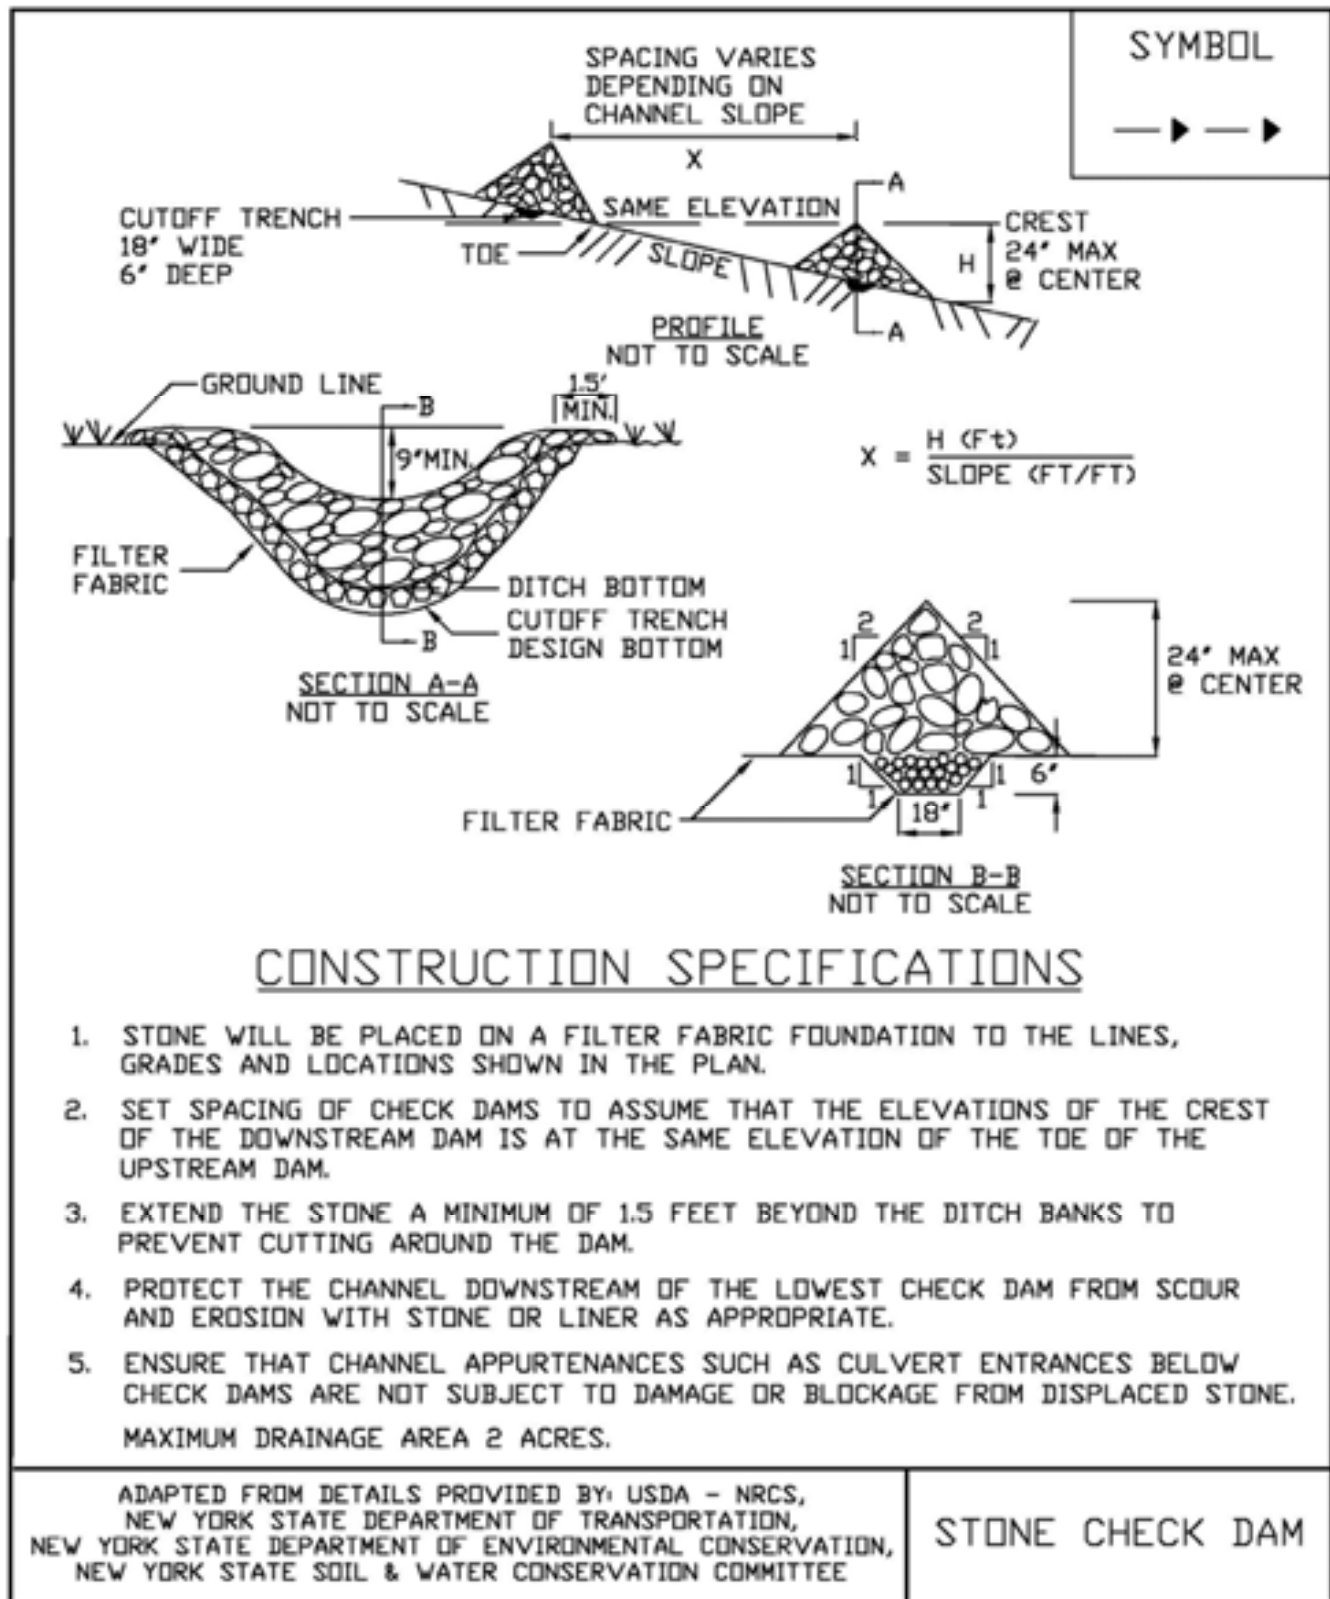

STANDARD AND SPECIFICATIONS FOR GRASSED WATERWAY



Definition & Scope

A natural or **permanent** man-made channel of parabolic or trapezoidal cross-section that is below adjacent ground level and is stabilized by suitable vegetation. The flow channel is normally wide and shallow and conveys the runoff down the slope without causing damage by erosion.

Conditions Where Practice Applies

Grass waterways are used where added vegetative protection is needed to control erosion resulting from concentrated runoff.

Design Criteria

Capacity

The minimum capacity shall be that required to confine the peak rate of runoff expected from a 10-year 24 hour frequency rainfall event or a higher frequency corresponding to the hazard involved. This requirement for confinement may be waived on slopes of less than one (1) percent where out-of-bank flow will not cause erosion or property damage.

Peak rates of runoff values used in determining the capacity requirements shall be computed by appropriate methods. Where there is base flow, it shall be handled by a stone center, subsurface drain, or other suitable means since sustained wetness usually prevents adequate vegetative cover. The cross-sectional area of the stone center or subsurface drain size to be provided shall be determined by using a flow rate of 0.1 cfs/acre or by actual measurement of the maximum base flow.

Velocity

Please see Table 3.1, Diversion Maximum Permissible Design Velocities on page 3.10, for seed, soil, and velocity variables.

Cross Section

The design water surface elevation of a grassed waterway receiving water from diversions or other tributary channels shall be equal to or less than the design water surface elevation in the diversion or other tributary channels.

The top width of parabolic waterways shall not exceed 30 feet and the bottom width of trapezoidal waterways shall not exceed 15 feet unless multiple or divided waterways, stone center, or other means are provided to control meandering of low flows.

Structural Measures

In cases where grade or erosion problems exist, special control measures may be needed such as lined waterways (see page 3.27), or grade stabilization measures (see page 3.21). Where needed, these measures will be supported by adequate design computations. For typical cross sections of waterways with riprap sections or stone centers, refer to Figure 3.8 on page 3.24.

The design procedures for parabolic and trapezoidal channels are available in the NRCS Engineering Field Handbook. Figure 3.9 on page 3.25 also provides a design chart for parabolic waterway.

Outlets

Each waterway shall have a stable outlet. The outlet may be another waterway, a stabilized open channel, grade stabilization structure, etc. In all cases, the outlet must discharge in such a manner as not to cause erosion. Outlets shall be constructed and stabilized prior to the operation of the waterway.


Stabilization

Waterways shall be stabilized in accordance with the appropriate vegetative stabilization standard and specifications, and will be dependent on such factors as slope, soil class, etc. See standard for Vegetating Waterways on Page 4.78.


Construction Specifications

See Figure 3.10 on page 3.26 for details.

Figure 3.8
Typical Waterway Cross Sections Details

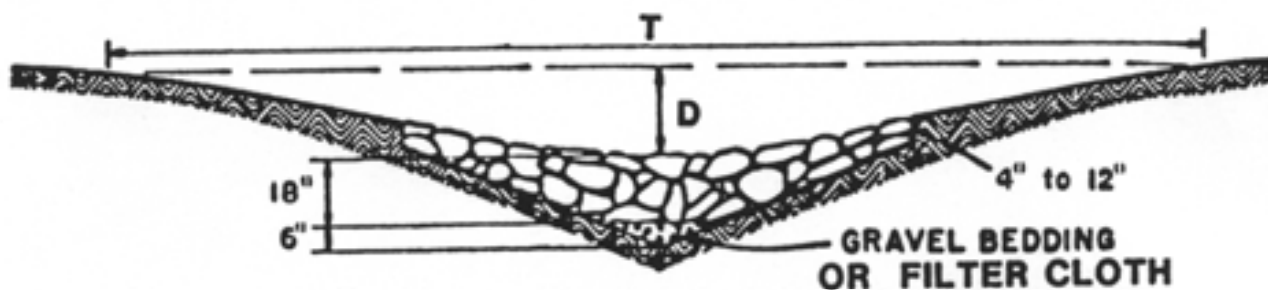


Waterway with stone center drain. "V"
 section shaped by motor grader.

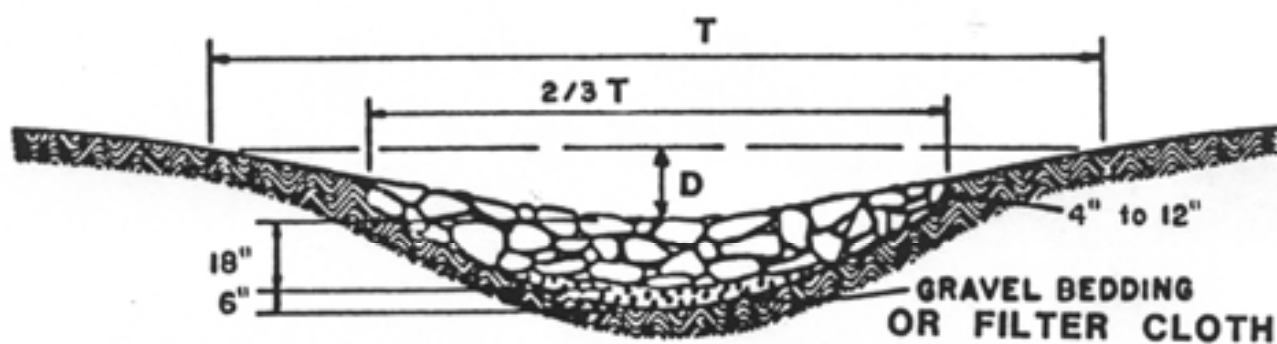

Waterway with stone center drain.
 Rounded section shaped by bulldozer.

Figure 3.10
Grassed Waterway Detail

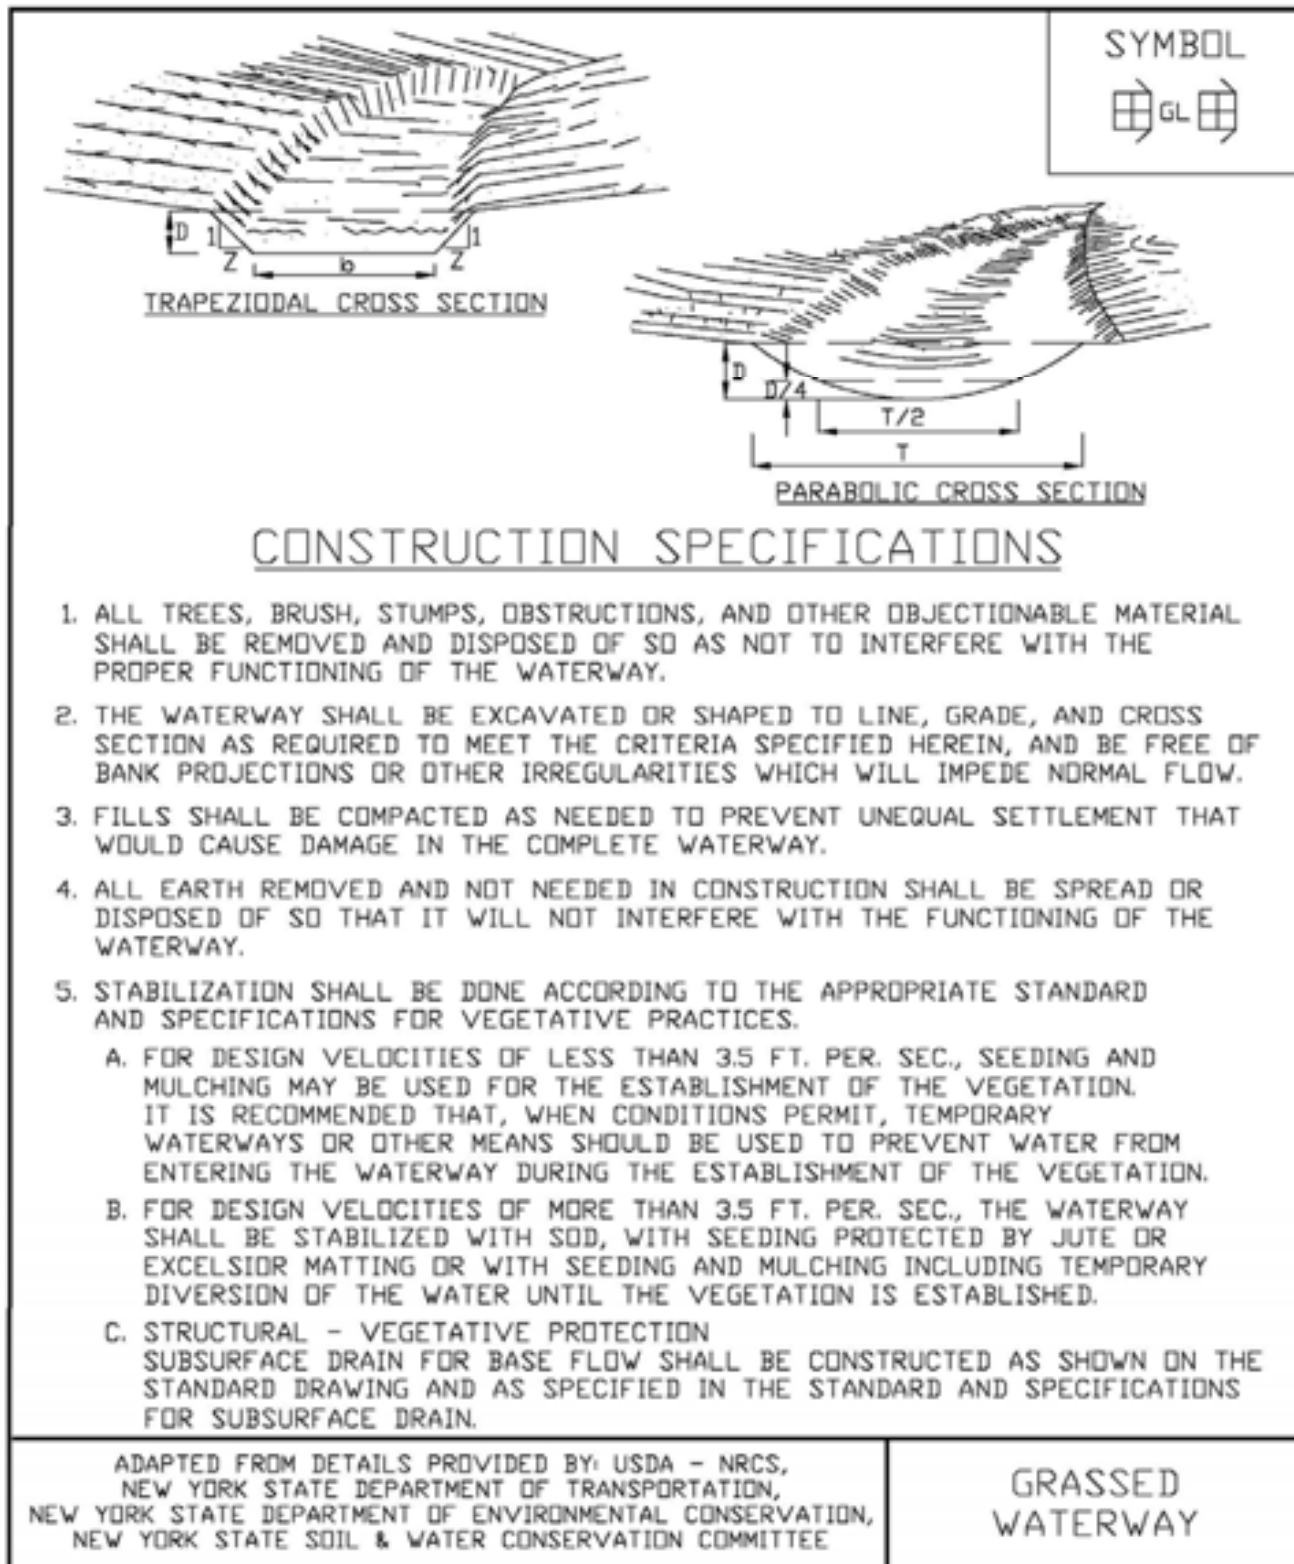

STANDARD AND SPECIFICATIONS FOR LINED WATERWAY



Definition & Scope

A **permanent** waterway or outlet with a lining of concrete, stone, or other durable, hardened material. The lined section extends up the side slopes to the designed depth. The earth above the permanent lining may be vegetated or otherwise protected.

The lined waterway is constructed to provide for the disposal of concentrated runoff without damage from erosion or flooding, where grassed waterways would be inadequate due to high velocities.

Conditions Where Practice Applies

This standard applies to waterways or outlets with linings of cast-in-place concrete, flagstone mortared in place, rock riprap, gabions, or similar permanent linings. It does not apply to irrigation ditch or canal linings, grassed waterways with stone centers or small lined sections that carry prolonged low flows, or to reinforced concrete channels. Lined waterways should not be used if they are directly discharging to C(T) or higher streams unless thermal impacts are mitigated by biotechnical practices (Section 4). The maximum capacity of the waterway flowing at design depth shall not exceed 100 cubic feet per second.

This practice applies where the following or similar conditions exist:

1. Concentrated runoff is such that a lining is required to control erosion.
2. Steep grades, wetness, prolonged base flow, seepage, or piping that would cause erosion.
3. The location is such that damage from use by people or animals precludes use of vegetated waterways or out-

lets.

4. Soils are highly erosive or other soil and climate conditions preclude using vegetation.
5. High value property or adjacent facilities warrant the extra cost to contain design runoff in a limited space.

Design Criteria

Capacity

1. The minimum capacity shall be adequate to carry the peak rate of runoff from a 10-year, 24-hour storm. Velocity shall be computed using Manning's equation with a coefficient of roughness "n" as follows:

Lined Material	"n"
Concrete (Type):	
Trowel Finish	0.015
Float Finish	0.019
Gunitite	0.019
Flagstone	0.022
Riprap	Determine from Figure 3.11 on page 3.30
Gabion	0.030

2. Riprap gradation and filter (bedding) are generally designed in accordance with criteria set forth in the National Cooperative Highway Research Program Report 108, available from the University Microfilm International, 300 N. Zeeb Road, Ann Arbor, Michigan 48106, Publication No. PB-00839; or the Hydraulic Engineering Circular No. 11, prepared by the U.S. Bureau of Public Roads, available from Federal Highway Administration, 400 7th Street, S.W., Washington, D.C. 20590, HNG-31, or the procedure in the USDA-NRCS's Engineering Field Manual, Chapter 16.

Velocity

1. Maximum design velocity shall be as shown below. Except for short transition sections, flow with a channel gradient within the range of 0.7 to 1.3 of this flow's critical slope must be avoided unless the channel is straight. Velocities exceeding critical will be restricted to straight reaches.

STANDARD AND SPECIFICATIONS FOR FIBER ROLL



Definition & Scope

A fiber roll is a coir (coconut fiber), straw, or excelsior roll encased in netting of jute, nylon, or burlap to dissipate energy along streambanks, channels, and bodies of water and to reduce sheet flow on slopes.

Conditions Where Practice Applies

Fiber rolls are used where the water surface levels are relatively constant. Artificially controlled streams for hydropower are not good candidates for this technique. The rolls provide a good medium for the introduction of herbaceous vegetation. Planting in the fiber roll is appropriate where the roll will remain continuously wet.

Design Criteria

1. The roll is placed in a shallow trench dug below baseflow or in a 4 inch trench on the slope contour and anchored by 2" x 2", 3-foot long posts driven on each side of the roll (see Figure 4.8).
2. The roll is contained by a 9-gauge non-galvanized wire placed over the roll from post to post. Braided nylon rope (1/8" thick) may be used.
3. The anchor posts shall be spaced laterally 4 feet on center on both sides of the roll and driven down to the top of the roll.
4. Soil is placed behind the roll and planted with suitable herbaceous or woody vegetation. If the roll will be continuously saturated, wetland plants may be planted into voids created in the upper surface of the roll.
5. Where water levels may fall below the bottom edge of the roll, a brush layer of willow should be installed so

as to lay across the top edge of the roll.


6. Where fiber rolls are used to reduce sheet flow on slopes they should be at least 12" in diameter and spaced according to the straw bale dike standard for sediment control.

Maintenance

Due to the susceptibility of plant materials to the physical constraints of the site, climate conditions, and animal populations, it is necessary to inspect installations frequently. This is especially important during the first year or two of establishment. Plant materials missing or damaged should be replaced as soon as possible. Sloughs or breaks in drainage pattern should be reestablished for the site as quickly as possible to maintain stability.



Figure 4.8
Fiber Roll

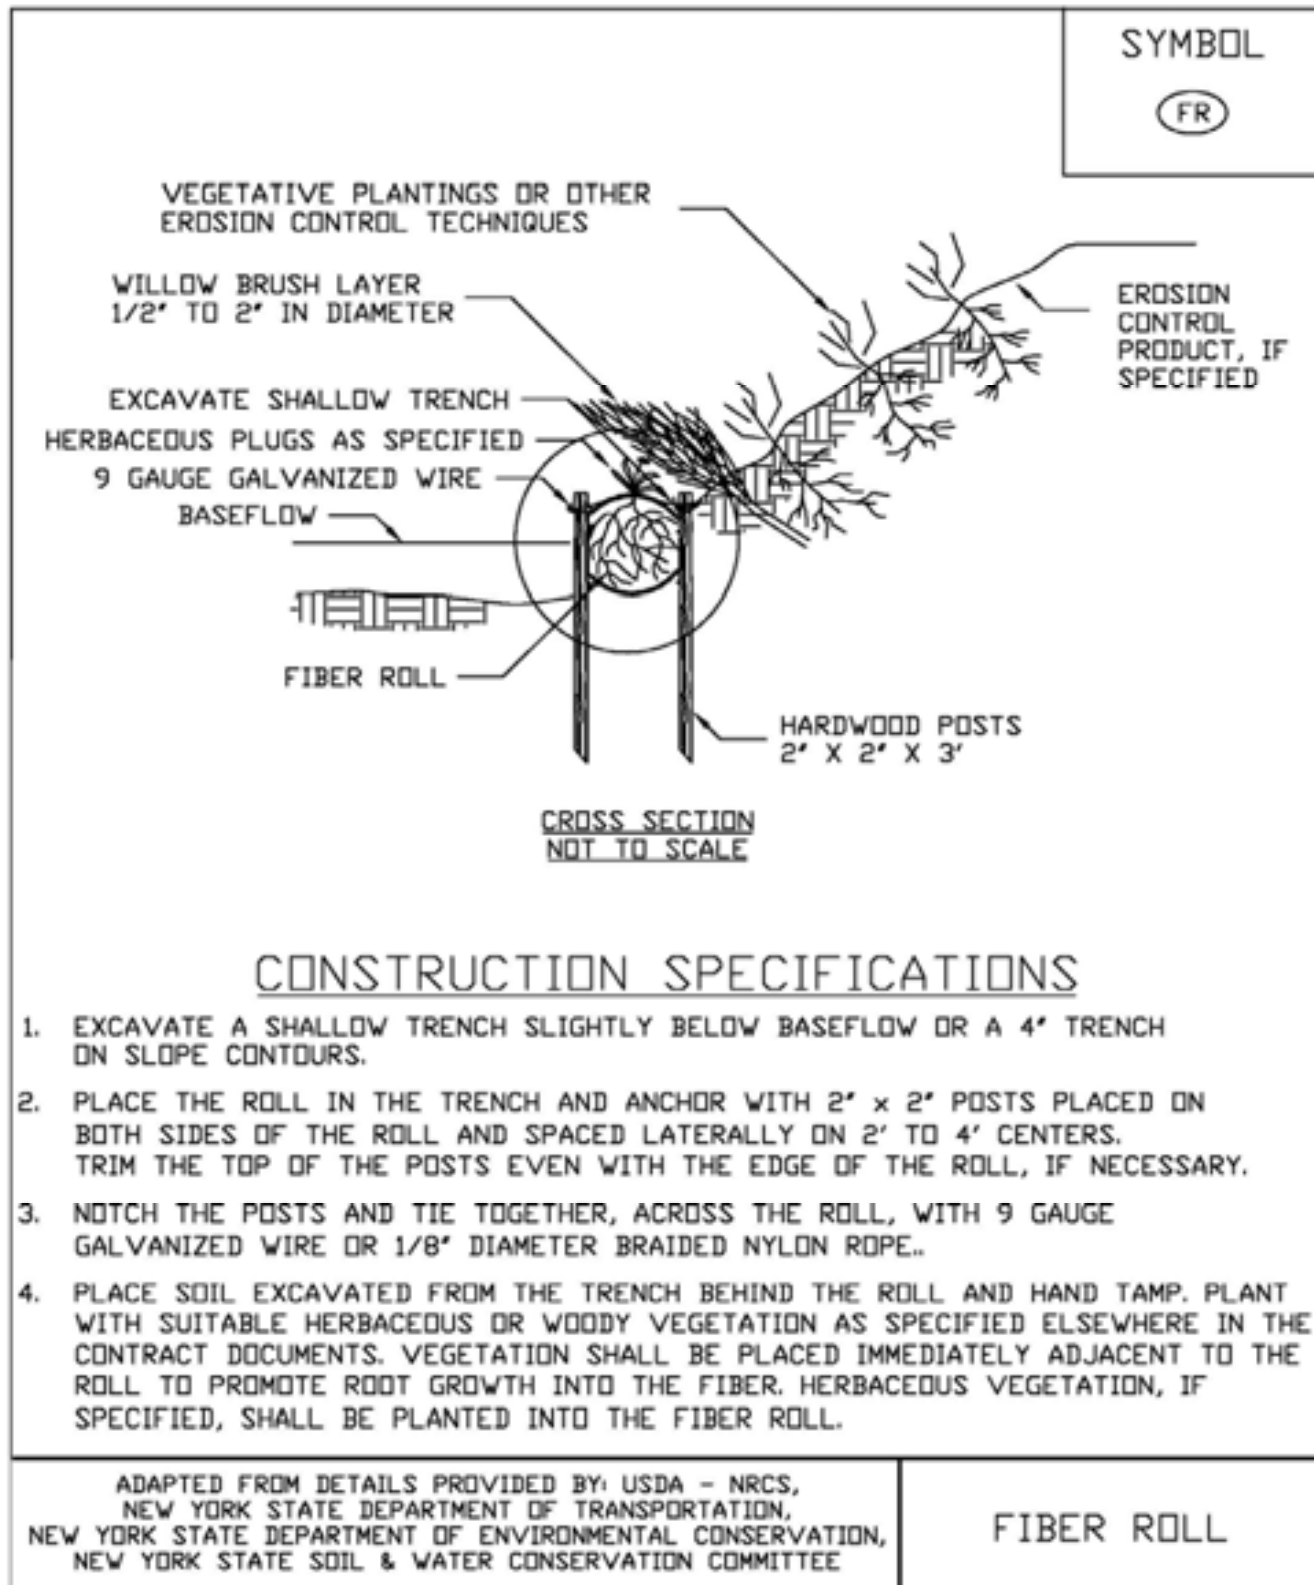

STANDARD AND SPECIFICATIONS FOR MULCHING



Definition and Scope

Applying coarse plant residue or chips, or other suitable materials, to cover the soil surface to provide initial erosion control while a seeding or shrub planting is establishing. Mulch will conserve moisture and modify the surface soil temperature and reduce fluctuation of both. Mulch will prevent soil surface crusting and aid in weed control. Mulch can also be used alone for temporary stabilization in non-growing months. Use of stone as a mulch could be more permanent and should not be limited to non-growing months.

Conditions Where Practice Applies

On soils subject to erosion and on new seedlings and shrub plantings. Mulch is useful on soils with low infiltration rates by retarding runoff.

Criteria

Site preparation prior to mulching requires the installation of necessary erosion control or water management practices and drainage systems.

Slope, grade and smooth the site to fit needs of selected mulch products.

Remove all undesirable stones and other debris to meet the needs of the anticipated land use and maintenance required.

Apply mulch after soil amendments and planting is accomplished or simultaneously if hydroseeding is used.

Select appropriate mulch material and application rate or material needs. Hay mulch shall not be used in wetlands or in areas of permanent seeding. Clean straw mulch is preferred alternative in wetland application. Determine local availability.

Select appropriate mulch anchoring material.

NOTE: The best combination for grass/legume establishment is straw (cereal grain) mulch applied at 2 ton/acre (90 lbs./1000sq.ft.) and anchored with wood fiber mulch (hydromulch) at 500 – 750 lbs./acre (11 – 17 lbs./1000 sq. ft.). The wood fiber mulch must be applied through a hydroseeder immediately after mulching.



Table 4.2
Guide to Mulch Materials, Rates, and Uses

Mulch Material	Quality Standards	per 1000 Sq. Ft.	per Acre	Depth of Application	Remarks
Wood chips or shavings	Air-dried. Free of objectionable coarse material	500-900 lbs.	10-20 tons	2-7"	Used primarily around shrub and tree plantings and recreation trails to inhibit weed competition. Resistant to wind blowing. Decomposes slowly.
Wood fiber cellulose (partly digested wood fibers)	Made from natural wood usually with green dye and dispersing agent	50 lbs.	2,000 lbs.	—	Apply with hydromulcher. No tie down required. Less erosion control provided than 2 tons of hay or straw.
Gravel, Crushed Stone or Slag	Washed; Size 2B or 3A—1 1/2"	9 cu. yds.	405 cu. yds.	3"	Excellent mulch for short slopes and around plants and ornamentals. Use 2B where subject to traffic. (Approximately 2,000 lbs./cu. yd.). Frequently used over filter fabric for better weed control.
Hay or Straw	Air-dried; free of undesirable seeds & coarse materials	90-100 lbs. 2-3 bales	2 tons (100-120 bales)	cover about 90% surface	Use small grain straw where mulch is maintained for more than three months. Subject to wind blowing unless anchored. Most commonly used mulching material. Provides the best micro-environment for germinating seeds.
Jute twisted yarn	Undyed, unbleached plain weave. Warp 78 ends/yd., Weft 41 ends/yd. 60-90 lbs./roll	48" x 50 yds. or 48" x 75 yds.	—	—	Use without additional mulch. Tie down as per manufacturers specifications. Good for center line of concentrated water flow.
Excelsior wood fiber mats	Interlocking web of excelsior fibers with photodegradable plastic netting	4' x 112.5' or 8' x 112.5'.	—	—	Use without additional mulch. Excellent for seeding establishment. Anchor as per manufacturers specifications. Approximately 72 lbs./roll for excelsior with plastic on both sides. Use two sided plastic for centerline of waterways.
Straw or coconut fiber, or combination	Photodegradable plastic net on one or two sides	Most are 6.5 ft. x 3.5 ft.	81 rolls	—	Designed to tolerate higher velocity water flow, centerlines of waterways, 60 sq. yds. per roll.

STANDARD AND SPECIFICATIONS FOR PERMANENT CONSTRUCTION AREA PLANTING



Definition & Scope

Establishing **permanent** grasses with other forbs and/or shrubs to provide a minimum 80% perennial vegetative cover on areas disturbed by construction and critical areas to reduce erosion and sediment transport. Critical areas may include but are not limited to steep excavated cut or fill slopes as well as eroding or denuded natural slopes and areas subject to erosion.

Conditions Where Practice Applies

This practice applies to all disturbed areas void of, or having insufficient, cover to prevent erosion and sediment transport. See additional standards for special situations such as sand dunes and sand and gravel pits.

Criteria

All water control measures will be installed as needed prior to final grading and seedbed preparation. Any severely compacted sections will require chiseling or disking to provide an adequate rooting zone, to a minimum depth of 12", see Soil Restoration Standard. The seedbed must be prepared to allow good soil to seed contact, with the soil not too soft and not too compact. Adequate soil moisture must be present to accomplish this. If surface is powder dry or sticky wet, postpone operations until moisture changes to a favorable condition. If seeding is accomplished within 24 hours of final grading, additional scarification is generally not needed, especially on ditch or stream banks. Remove all stones and other debris from the surface that are greater than 4 inches, or that will interfere with future mowing or maintenance.

Soil amendments should be incorporated into the upper 2 inches of soil when feasible. **The soil should be tested to determine the amounts of amendments needed.** Apply

ground agricultural limestone to attain a pH of 6.0 in the upper 2 inches of soil. If soil must be fertilized before results of a soil test can be obtained to determine fertilizer needs, apply commercial fertilizer at 600 lbs. per acre of 5-5-10 or equivalent. If manure is used, apply a quantity to meet the nutrients of the above fertilizer. This requires an appropriate manure analysis prior to applying to the site. Do not use manure on sites to be planted with birdsfoot trefoil or in the path of concentrated water flow.

Seed mixtures may vary depending on location within the state and time of seeding. Generally, warm season grasses should only be seeded during early spring, April to May. These grasses are primarily used for vegetating excessively drained sands and gravels. See Standard and Specification for Sand and Gravel Mine Reclamation. Other grasses may be seeded any time of the year when the soil is not frozen and is workable. When legumes such as birdsfoot trefoil are included, spring seeding is preferred. See Table 4.4, "Permanent Construction Area Planting Mixture Recommendations" for additional seed mixtures.

General Seed Mix:	Variety	lbs./acre	lbs/1000 sq. ft.
Red Clover ¹ <u>OR</u>	Acclaim, Rally, Red Head II, Renegade	8 ²	0.20
Common white clover ¹	Common	8	0.20
<u>PLUS</u>			
Creeping Red Fescue	Common	20	0.45
<u>PLUS</u>			
Smooth Bromegrass <u>OR</u>	Common	2	0.05
Ryegrass (perennial)	Pennfine/Linn	5	0.10
¹ add inoculant immediately prior to seeding ² Mix 4 lbs each of Empire and Pardee <u>OR</u> 4 lbs of Birdsfoot and 4 lbs white clover per acre. All seeding rates are given for Pure Live Seed (PLS)			

Pure Live Seed, or (PLS) refers to the amount of live seed in a lot of bulk seed. Information on the seed bag label includes the type of seed, supplier, test date, source of seed, purity, and germination. Purity is the percentage of pure seed. Germination is the percentage of pure seed that will produce normal plants when planted under favorable conditions.

To compute Pure Live Seed multiply the “germination percent” times the “purity” and divide that by 100 to get Pure Live Seed.

$$\text{Pure Live Seed (PLS)} = \frac{\% \text{ Germination} \times \% \text{ Purity}}{100}$$

For example, the PLS for a lot of Kentucky Blue grass with 75% purity and 96% germination would be calculated as follows:

$$\frac{(96) \times (75)}{100} = 72\% \text{ Pure Live Seed}$$

For 10lbs of PLS from this lot =

$$\frac{10}{0.72} = 13.9 \text{ lbs}$$

Therefore, 13.9 lbs of seed is the actual weight needed to meet 10lbs PSL from this specific seed lot.

Time of Seeding: The optimum timing for the general seed mixture is early spring. Permanent seedings may be made any time of year if properly mulched and adequate moisture is provided. Late June through early August is not a good time to seed, but may facilitate covering the land without additional disturbance if construction is completed. Portions of the seeding may fail due to drought and heat. These areas may need reseeding in late summer/fall or the following spring.

Method of seeding: Broadcasting, drilling, cultipack type seeding, or hydroseeding are acceptable methods. Proper soil to seed contact is key to successful seedings.

Mulching: Mulching is essential to obtain a uniform stand of seeded plants. Optimum benefits of mulching new seedings are obtained with the use of small grain straw applied at a rate of 2 tons per acre, and anchored with a netting or tackifier. See the Standard and Specifications for Mulching for choices and requirements.

Irrigation: Watering may be essential to establish a new seeding when a drought condition occurs shortly after a new seeding emerges. Irrigation is a specialized practice and care must be taken not to exceed the application rate for the soil or subsoil. When disconnecting irrigation pipe, be sure pipes are drained in a safe manor, not creating an erosion concern.



80% Perennial Vegetative Cover



50% Perennial Vegetative Cover

STANDARD AND SPECIFICATIONS FOR STABILIZATION WITH SOD



Definition & Scope

Stabilizing restored, exposed soil surfaces by establishing long term stands of grass with sod to reduce damage from sediment and runoff to downstream areas and enhance natural beauty.

Conditions Where Practice Applies

On exposed soils that have a potential for causing off site environmental damage where a quick vegetative cover is desired. Moisture, either applied or natural, is essential to success.

Design Criteria

1. Sod shall be bluegrass or a bluegrass/red fescue mixture or a perennial ryegrass for average sites. (CAUTION: Perennial ryegrass has limited cold tolerance and may winter kill.) Use turf type cultivars of tall fescue for shady, droughty, or otherwise more critical areas. For variety selection, contact Cornell Cooperative Extension Turf Specialist.
2. Sod shall be machine cut at a uniform soil thickness of 3/4 inch, plus or minus 1/4 inch. Measurement for thickness shall exclude top growth and thatch.
3. Standard size sections of sod shall be strong enough to support their own weight and retain their size and shape when suspended vertically from a firm grasp on the upper 10 percent of the section.
4. Sod shall be free of weeds and undesirable coarse weedy grasses. Wild native or pasture grass sod shall not be used unless specified.
5. Sod shall not be harvested or transplanted when

moisture content (excessively dry or wet) may adversely affect its survival.

6. Sod shall be harvested, delivered, and installed within a period of 36 hours. Sod not transplanted within this period shall be inspected and approved by the contracting officer or his designated representative prior to its installation.

Site Preparation

Fertilizer and lime application rates shall be determined by soil tests. Under unusual circumstances where there is insufficient time for a complete soil test and the contracting officer agrees, fertilizer and lime materials may be applied in amounts shown in subsection 2 below. Slope land such as to provide good surface water drainage. Avoid depressions or pockets.

1. Prior to sodding, the surface shall be smoothed and cleared of all trash, debris, and of all roots, brush, wire, grade stakes and other objects that would interfere with planting, fertilizing or maintenance operations.
2. **The soil should be tested to determine the amounts of amendments needed.** Where the soil is acid or composed of heavy clays, ground limestone shall be spread to raise the pH to 6.5. If the soil must be fertilized before results of a soil test can be obtained to determine fertilizer needs, apply commercial fertilizer at 20 lbs. of 5-5-10 (or equivalent) and mix into the top 3 inches of soil with the required lime for every 1,000 square feet. Soil should be moist prior to sodding. Arrange for temporary storage of sod to keep it shaded and cool.

Sod Installation

1. For the operation of laying, tamping, and irrigating for any areas, sod shall be completed within eight hours. During periods of excessively high temperature, the soil shall be lightly moistened immediately prior to laying the sod.
2. The first row of sod shall be laid in a straight line with subsequent rows placed parallel to, and tightly wedged against, each other. Lateral joints shall be staggered to promote more uniform growth and strength. Ensure that sod is not stretched or overlapped and that all joints are butted tight in order to prevent voids which would cause air drying of the roots. On sloping areas where erosion may be a problem, sod shall be laid with the long edges parallel to the contour and with

staggered joints.

3. Secure the sod by tamping and pegging, or other approved methods. As sodding is completed in any one section, the entire area shall be rolled or tamped to ensure solid contact of roots with the soil surface.
4. Sod shall be watered immediately after rolling or tamping until the underside of the new sod pad and soil surface below the sod are thoroughly wet. Keep sod moist for at least two weeks.

Sod Maintenance

1. In the absence of adequate rainfall, watering shall be performed daily, or as often as deemed necessary by the inspector, during the first week and in sufficient quantities to maintain moist soil to a depth of 4 inches. Watering should be done in the morning. Avoid excessive watering during applications.
2. After the first week, sod shall be watered as necessary to maintain adequate moisture and ensure establishment.
3. The first mowing should not be attempted until sod is firmly rooted. No more than 1/3 of the grass leaf shall be removed by the initial cutting or subsequent cuttings. Grass height shall be maintained between 2 and 3 inches unless otherwise specified. Avoid heavy mowing equipment for several weeks to prevent rutting.
4. If the soil must be fertilized before results of a soil test can be obtained to determine fertilizer needs, apply fertilizer three to four weeks after sodding, at a rate of 1 pound nitrogen/1,000 sq.ft. Use a complete fertilizer with a 2-1-1 ratio.
5. Weed Control: Target herbicides for weeds present. Consult current Cornell Pest Control Recommendations for Commercial Turfgrass Management or consult the local office of Cornell Cooperative Extension.
6. Disease Control: Consult the local office of the Cornell Cooperative Extension.

Additional References

1. Home Lawns, Establishment and Maintenance, CCE Information Bulletin 185, Revised November 1994. Cornell University, Ithaca, NY.
2. Installing a Sod Lawn. CCE Suffolk County, NY. Thomas Kowalsick February 1994, Revised January 1999. www.cce.cornell.edu/counties/suffolk/grownet

STANDARD AND SPECIFICATIONS FOR COMPOST FILTER SOCK



that 8" diameter socks may be used for residential lots to control areas less than 0.25 acres.

- The flat dimension of the sock shall be at least 1.5 times the nominal diameter.
- The **Maximum Slope Length** (in feet) above a compost filter sock shall not exceed the following limits:

Dia. (in.)	Slope %						
	2	5	10	20	25	33	50
8	225*	200	100	50	20	—	—
12	250	225	125	65	50	40	25
18	275	250	150	70	55	45	30
24	350	275	200	130	100	60	35
32	450	325	275	150	120	75	50

* Length in feet

Definition & Scope

A **temporary** sediment control practice composed of a degradable geotextile mesh tube filled with compost filter media to filter sediment and other pollutants associated with construction activity to prevent their migration offsite.

Condition Where Practice Applies

Compost filter socks can be used in many construction site applications where erosion will occur in the form of sheet erosion and there is no concentration of water flowing to the sock. In areas with steep slopes and/or rocky terrain, soil conditions must be such that good continuous contact between the sock and the soil is maintained throughout its length. For use on impervious surfaces such as road pavement or parking areas, proper anchorage must be provided to prevent shifting of the sock or separation of the contact between the sock and the pavement. Compost filter socks are utilized both at the site perimeter as well as within the construction areas. These socks may be filled after placement by blowing compost into the tube pneumatically, or filled at a staging location and moved into its designed location.

Design Criteria

- Compost filter socks will be placed on the contour with both terminal ends of the sock extended 8 feet upslope at a 45 degree angle to prevent bypass flow.
- Diameters designed for use shall be 12" – 32" except



- The compost infill shall be well decomposed (matured at least 3 months), weed-free, organic matter. It shall be aerobically composted, possess no objectionable odors, and contain less than 1%, by dry weight, of man-made foreign matter. The physical parameters of the compost shall meet the standards listed in Table 5.2 - Compost Standards Table. **Note: All biosolids compost produced in New York State (or approved for importation) must meet NYS DEC's 6 NYCRR Part 360 (Solid Waste Management Facilities) requirements. The Part 360 requirements are equal to or more stringent than 40 CFR Part 503 which ensure safe standards for pathogen reduction and heavy metals content. When using compost filter socks adjacent to surface water, the compost should have a low nutrient value.**
- The compost filter sock fabric material shall meet the

7. Compost filter socks shall be anchored in earth with 2" x 2" wooden stakes driven 12" into the soil on 10 foot centers on the centerline of the sock. On uneven terrain, effective ground contact can be enhanced by the placement of a fillet of filter media on the disturbed area side of the compost sock.
8. All specific construction details and material specifications shall appear on the erosion and sediment control constructions drawings when compost filter socks are included in the plan.
3. Socks shall be inspected weekly and after each runoff event. Damaged socks shall be repaired in the manner required by the manufacturer or replaced within 24 hours of inspection notification.
4. Biodegradable filter socks shall be replaced after 6 months; photodegradable filter socks after 1 year. Polypropylene socks shall be replaced according to the manufacturer's recommendations.
5. Upon stabilization of the area contributory to the sock, stakes shall be removed. The sock may be left in place and vegetated or removed in accordance with the stabilization plan. For removal the mesh can be cut and the compost spread as an additional mulch to act as a soil supplement.

Maintenance

1. Traffic shall not be permitted to cross filter socks.
2. Accumulated sediment shall be removed when it reaches half the above ground height of the sock and disposed of in accordance with the plan.


Table 5.1 - Compost Sock Fabric Minimum Specifications Table

Material Type	3 mil HDPE	5 mil HDPE	5 mil HDPE	Multi-Filament Polypropylene (MFPP)	Heavy Duty Multi-Filament Polypropylene (HDMFPP)
Material Characteristics	Photodegradable	Photodegradable	Biodegradable	Photodegradable	Photodegradable
Sock Diameters	12" 18"	12" 18" 24" 32"	12" 18" 24" 32"	12" 18" 24" 32"	12" 18" 24" 32"
Mesh Opening	3/8"	3/8"	3/8"	3/8"	1/8"
Tensile Strength		26 psi	26 psi	44 psi	202 psi
Ultraviolet Stability % Original Strength (ASTM G-155)	23% at 1000 hr.	23% at 1000 hr.		100% at 1000 hr.	100% at 1000 hr.
Minimum Functional Longevity	6 months	9 months	6 months	1 year	2 years

Table 5.2 - Compost Standards Table

Organic matter content	25% - 100% (dry weight)
Organic portion	Fibrous and elongated
pH	6.0 – 8.0
Moisture content	30% - 60%
Particle size	100% passing a 1" screen and 10 - 50% passing a 3/8" screen
Soluble salt concentration	5.0 dS/m (mmhos/cm) maximum

Figure 5.2
Compost Filter Sock

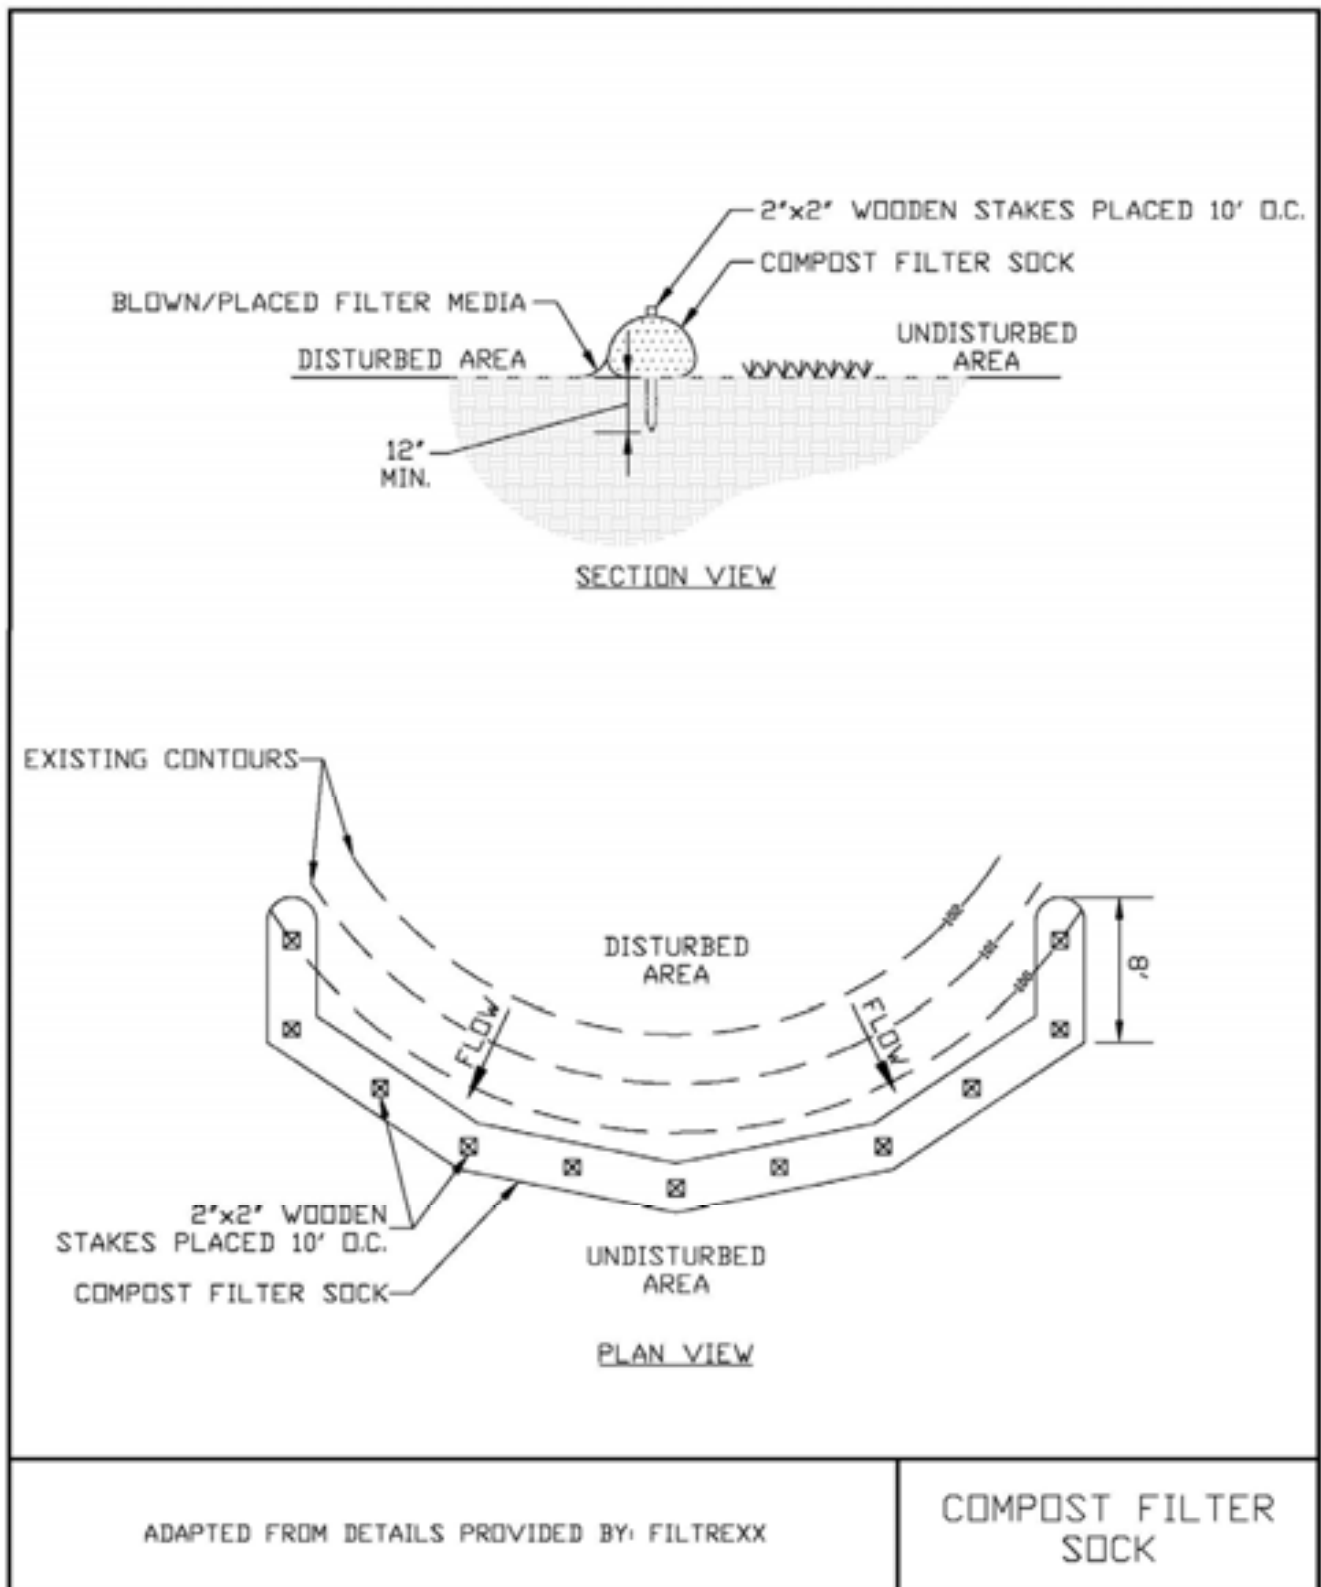

STANDARD AND SPECIFICATIONS FOR SEDIMENT BASIN



Definition & Scope

A **temporary** basin with a barrier or dam constructed across a drainage way or at other suitable locations to intercept sediment-laden runoff and reduce the amount of sediment leaving the disturbed area in order to protect drainageways, properties, and rights-of-way below the sediment basin.

Conditions Where Practice Applies

A sediment basin is appropriate where physical site conditions or land ownership restrictions preclude the installation of other control measures to adequately control runoff, erosion, and sedimentation. However, it is required that other erosion control measures be used with the sediment basin. The basin may be used below construction operations which expose critical areas to soil erosion. The basin shall be maintained until the disturbed area is protected against erosion by permanent stabilization.

This standard applies to the installation of temporary sediment basins on sites where: (a) failure of the structure would not result in loss of life, damage to homes or buildings, or interruption of use or service of public roads or utilities; (b) the drainage area does not exceed 50 acres; and (c) the basin is to be removed within 36 months after the beginning of construction of the basin.

Permanent (to function more than 36 months) sediment basins, or structures that temporarily function as a sediment basin but are intended for use as a permanent pool shall be classified as **permanent** structures and shall conform to criteria appropriate for permanent structures. These structures shall be designed and constructed to conform to NRCS Standard And Specification No. 378 for Ponds in the National Handbook of Conservation Practices and the New York State Department of Environmental Conservation, "Guidelines for the Design of Dams."

Design Criteria

Compliance with Laws and Regulations

Design and construction shall comply with state and local laws, ordinances, rules and regulations, including permits.

Location - Maximum Drainage Area = 50 acres

The sediment basin should be located to obtain the maximum storage benefit from the terrain and for ease of cleanout of the trapped sediment. It should be located to minimize interference with construction activities and construction of utilities. Whenever possible, sediment basins should be located so that storm drains may outfall or be diverted into the basin. **Do not locate basins in perennial streams.**

Size and Shape of the Basin

The sediment basin will contain two separate zones. The lowest zone is the sediment storage zone. This zone is sized for a volume equal to 1,000 cubic feet per disturbed acre over the course of the life of the project, contributing to the basin as measured from the bottom of the basin to the bottom of the dewatering zone. It shall have a minimum depth of 1 foot. Layered above this zone is the dewatering zone. This zone is sized for a minimum volume equal to 3,600 cubic feet per each acre draining to the basin. This volume is temporarily stored between the sediment storage zone and the crest of the principal spillway. This zone should be a minimum of 3 feet deep. See Figures 5.8 and 5.9 on pages 5.26 and 5.27. This 3,600 cubic feet per acre is equivalent to one inch of sediment per acre of drainage area. The entire drainage area is used for this computation, rather than the disturbed area above, to maximize trapping efficiency. The length to width ratio shall be 2:1 or greater, where length is the distance between the inlet and outlet. A wedge shape shall be used with the inlet located at the narrow end. See Figure 5.22 on page 5.41.

Surface Area

Research studies (Barfield and Clar 1985; Pitt, 2003) indicate that the following relationship between surface area and peak inflow rate gives a trapping efficiency of 75% for silt loam soils, and greater than 90% for loamy sand soils:

$$A = 0.01 Q_p \text{ or, } A = 0.015x \text{ D.A. (whichever is greater)}$$

where,

STANDARD AND SPECIFICATIONS FOR SEDIMENT TRAP



Definition & Scope

A **temporary** sediment control device formed by excavation and/or embankment to intercept sediment-laden runoff and trap the sediment in order to protect drainageways, properties, and rights-of-way below the sediment trap from sedimentation.

Conditions Where Practice Applies

A sediment trap is usually installed in a drainageway, at a storm drain inlet, or other points of collection from a disturbed area for one construction season.

Sediment traps should be used to artificially break up the natural drainage area into smaller sections where a larger device (sediment basin) would be less effective.

Design Criteria

If the drainage area to the proposed trap location exceeds 5 acres, or the trap is in place beyond one construction season, or any of the additional design criteria presented here cannot be met, a full Sediment Basin must be used. See Standard and Specification for Sediment Basin on page 5.19.

Drainage Area

The maximum drainage area for all sediment traps shall be 5 acres.

Location

Sediment traps shall be located so that they can be installed prior to grading or filling in the drainage area they are to protect. Traps must **not be located any closer than 20 feet** from a proposed building foundation if the trap is to func-

tion during building construction. Locate traps to obtain maximum storage benefit from the terrain and for ease of cleanout and disposal of the trapped sediment.

Trap Size

The volume of a sediment trap as measured at the elevation of the crest of the outlet shall be at least 3,600 cubic feet per acre of drainage area. A minimum length to width ratio of 2:1 should be provided. The volume of a constructed trap shall be calculated using standard mathematical procedures. The volume of a natural sediment trap may be approximated by the equation: Volume (cu.ft.) = 0.4 x surface area (sq.ft.) x maximum depth (ft.).

Trap Cleanout

Sediment shall be removed and the trap restored to the original dimensions when the sediment has accumulated to $\frac{1}{2}$ of the design depth of traps I-II, and $\frac{1}{3}$ the depth for trap III. Sediment removed from the trap shall be deposited in a protected area and in such a manner that it will not erode.

Embankment

All earth embankments for sediment traps shall not exceed five (5) feet in height as measured at the low point of the original ground along the centerline of the embankment. Embankments shall have a minimum four (4) foot wide top and side slopes of 2:1 or flatter. The embankment shall be compacted by traversing with equipment while it is being constructed. The embankment shall be stabilized with seed and mulch as soon as it is completed.

The elevation of the top of any dike directing water to any sediment trap will equal or exceed the maximum height of the outlet structure along the entire length of the trap.

Excavation

All excavation operations shall be carried out in such a manner that erosion and water pollution shall be minimal. Excavated portions of sediment traps shall have 1:1 or flatter slopes.

Outlet

The outlet shall be designed, constructed, and maintained in such a manner that sediment does not leave the trap and that erosion at or below the outlet does not occur.

Sediment traps must outlet onto stabilized (preferable undisturbed) ground, into a watercourse, stabilized channel, or into a storm drain system. Distance between inlet and outlet should be maximized to the longest length practicable.

All traps must be seeded and mulched immediately after construction.

Trap Details Needed on Erosion and Sediment Control Plans

Each trap shall be delineated on the plans in such a manner that it will not be confused with any other features. Each trap on a plan shall indicate all the information necessary to properly construct and maintain the structure. If the drawings are such that this information cannot be delineated on the drawings, then a table shall be developed. If a table is developed, then each trap on a plan shall have a number and the numbers shall be consecutive.

The following information shall be shown for each trap in a summary table format on the plans.

1. Trap number
2. Type of trap
3. Drainage area
4. Storage required
5. Storage provided (if applicable)
6. Outlet length or pipe sizes
7. Storage depth below outlet or cleanout elevation
8. Embankment height and elevation (if applicable)

Type of Sediment Traps

There are three (3) specific types of sediment traps which vary according to their function, location, or drainage area.

- I. Pipe Outlet Sediment Trap
- II. Stone Outlet Sediment Trap
- III. Compost Filter Sock Sediment Trap

I. Pipe Outlet Sediment Trap

A Pipe Outlet Sediment Trap consists of a trap formed by embankment or excavation. The outlet for the trap is through a perforated riser and a pipe through the embankment. The outlet pipe and riser shall be made of steel, corrugated metal or other suitable material. The top of the embankment shall be at least 1 ½ feet above the crest of the riser. The preferred method of dewatering the sediment trap is by surface skimmer. See Dewatering Device Standard, page 5.10. If the riser alone is used for dewatering, the top 2/3 of the riser shall be perforated with one (1) inch nominal diameter holes or slits spaced six (6) inches vertically and horizontally placed in the concave portion of the corrugated pipe.

No holes or slits will be allowed within six (6) inches of the top of the horizontal barrel. All pipe connections shall be watertight. The riser shall be wrapped with ½ to ¼ inch hardware cloth wire then wrapped with filter cloth with a sieve size between #40-80 and secured with strapping or connecting band at the top and bottom of the cloth. The

cloth shall cover an area at least six (6) inches above the highest hole and six (6) inches below the lowest hole. The top of the riser pipe shall not be covered with filter cloth. The riser shall have a base with sufficient weight to prevent flotation of the riser. Two approved bases are:

1. A concrete base 12 in. thick with the riser embedded 9 in. into the concrete base, or
2. One quarter inch, minimum, thick steel plate attached to the riser by a continuous weld around the circumference of the riser to form a watertight connection. The plate shall have 2.5 feet of stone, gravel, or earth placed on it to prevent flotation. In either case, each side of the square base measurement shall be the riser diameter plus 24 inches.

Pipe outlet sediment traps shall be limited to a five (5) acre maximum drainage area. Pipe outlet sediment trap is interchangeable in the field with stone outlet provided that these sediment traps are constructed in accordance with the detail and specifications for that trap.

Select pipe diameter from the following table:
See details for Pipe Outlet Sediment Trap ST-I in Figure 5.25 and 5.26 on pages 5.49 and 5.50.

Optional sediment trap dewatering devices are shown on Figure 5.29 on Page 5.53.

Minimum Sizes

Barrel Diameter ¹ (in.)	Riser Diameter ¹ (in.)	Maximum Drainage Area (ac.)
12	15	1
15	18	2
18	21	3
21	24	4
21	27	5

¹ Barrel diameter may be same size as riser diameter



II. Stone Outlet Sediment Trap

A Stone Outlet Sediment Trap consists of a trap formed by an embankment or excavation. The outlet of this trap is over a stone section placed on level ground. The minimum length (feet) of the outlet shall be equal to four (4) times the drainage area (acres).

Required storage shall be 3,600 cubic feet per acre of drainage area.

The outlet crest (top of stone in weir section) shall be level, at least one (1) foot below top of embankment and no more than one (1) foot above ground beneath the outlet. Stone used in the outlet shall be small riprap (4 in. x 8 in.). To provide more efficient trapping effect, a layer of filter cloth should be embedded one (1) foot back into the upstream face of the outlet stone or a one (1) foot thick layer of two (2) inch or finer aggregate shall be placed on the upstream face of the outlet.

Stone Outlet Sediment Traps may be interchangeable in the field with pipe outlet sediment traps provided they are constructed in accordance with the detail and specifications for those traps. Stone outlet sediment traps shall be limited to a five (5) acre maximum drainage area.

See details for Stone Outlet Sediment Trap ST-II in Figure 5.27 on page 5.51



III. Compost Sock Sediment Trap

A compost sock sediment trap consists of a trap formed by creating an enclosure of geotextile mesh tubes filled with a compost filter media. These traps are used in locations where there is no opportunity to direct runoff into larger traps or well vegetated areas. This could occur at site entrances and access points or in tight areas due to construction boundary limits.

Surface runoff can be directed to the trap with standard conveyance practices. Groundwater or surface ponding in low areas can be pumped into the compost sock sediment trap with appropriate energy dissipation at the pump outlet to prevent scour.

Design criteria for Compost Sock Sediment Trap

1. The maximum drainage area tributary to the trap shall be 5 acres.
2. The minimum settled height above ground shall be 2.0 feet formed by staking 3 compost filter socks in a pyramid as shown in Figure 5.28 on page 5.52.
3. The storage volume provided in the compost sock sediment trap shall be 3,600 cubic feet per tributary drainage acre.
4. If necessary, additional storage area can be created by excavating a sump 1 foot deep beginning at least 5 feet away from the inside sock.
5. All compost filter sock materials, mesh, and compost, will meet the material specifications listed in the Compost Filter Sock standard. No spillway is required.
6. Compost filter sock sediment traps shall be inspected weekly and after every rainfall event. Sediment shall be removed when it reaches one third, $\frac{1}{3}$, the height of the trap.
7. The maximum limit of use for a compost sock sediment trap is one (1) year. The existing trap shall be replaced if there is a need for a trap beyond that time limit.
8. Upon completion of the work, the compost sock sediment trap shall be removed. The compost within the socks may be used during cleanup as a vegetative growth medium in accordance with the site stabilization plan.



STANDARD AND SPECIFICATIONS FOR SILT FENCE



Definition & Scope

A **temporary** barrier of geotextile fabric installed on the contours across a slope used to intercept sediment laden runoff from small drainage areas of disturbed soil by temporarily ponding the sediment laden runoff allowing settling to occur. The maximum period of use is limited by the ultraviolet stability of the fabric (approximately one year).

Conditions Where Practice Applies

A silt fence may be used subject to the following conditions:

1. Maximum allowable slope length and fence length will not exceed the limits shown in the Design Criteria for the specific type of silt fence used ; and
2. Maximum ponding depth of 1.5 feet behind the fence; and
3. Erosion would occur in the form of sheet erosion; and
4. There is no concentration of water flowing to the barrier; and
5. Soil conditions allow for proper keying of fabric, or other anchorage, to prevent blowouts.

Design Criteria

1. Design computations are not required for installations of 1 month or less. Longer installation periods should be designed for expected runoff.
2. All silt fences shall be placed as close to the disturbed area as possible, but at least 10 feet from the toe of a slope steeper than 3H:1V, to allow for maintenance and

roll down. The area beyond the fence must be undisturbed or stabilized.

3. The type of silt fence specified for each location on the plan shall not exceed the maximum slope length and maximum fence length requirements shown in the following table:

		Slope Length/Fence Length (ft.)		
Slope	Steepness	Standard	Reinforced	Super
<2%	< 50:1	300/1500	N/A	N/A
2-10%	50:1 to 10:1	125/1000	250/2000	300/2500
10-20%	10:1 to 5:1	100/750	150/1000	200/1000
20-33%	5:1 to 3:1	60/500	80/750	100/1000
33-50%	3:1 to 2:1	40/250	70/350	100/500
>50%	> 2:1	20/125	30/175	50/250

Standard Silt Fence (SF) is fabric rolls stapled to wooden stakes driven 16 inches in the ground.

Reinforced Silt Fence (RSF) is fabric placed against welded wire fabric with anchored steel posts driven 16 inches in the ground.

Super Silt Fence (SSF) is fabric placed against chain link fence as support backing with posts driven 3 feet in the ground.


4. Silt fence shall be removed as soon as the disturbed area has achieved final stabilization.

The silt fence shall be installed in accordance with the appropriate details. Where ends of filter cloth come together, they shall be overlapped, folded and stapled to prevent sediment bypass. Butt joints are not acceptable. A detail of the silt fence shall be shown on the plan. See Figure 5.30 on page 5.56 for Reinforced Silt Fence as an example of details to be provided.

Criteria for Silt Fence Materials

1. Silt Fence Fabric: The fabric shall meet the following specifications unless otherwise approved by the appropriate erosion and sediment control plan approval authority. Such approval shall not constitute statewide acceptance.

**Figure 5.30
Reinforced Silt Fence**

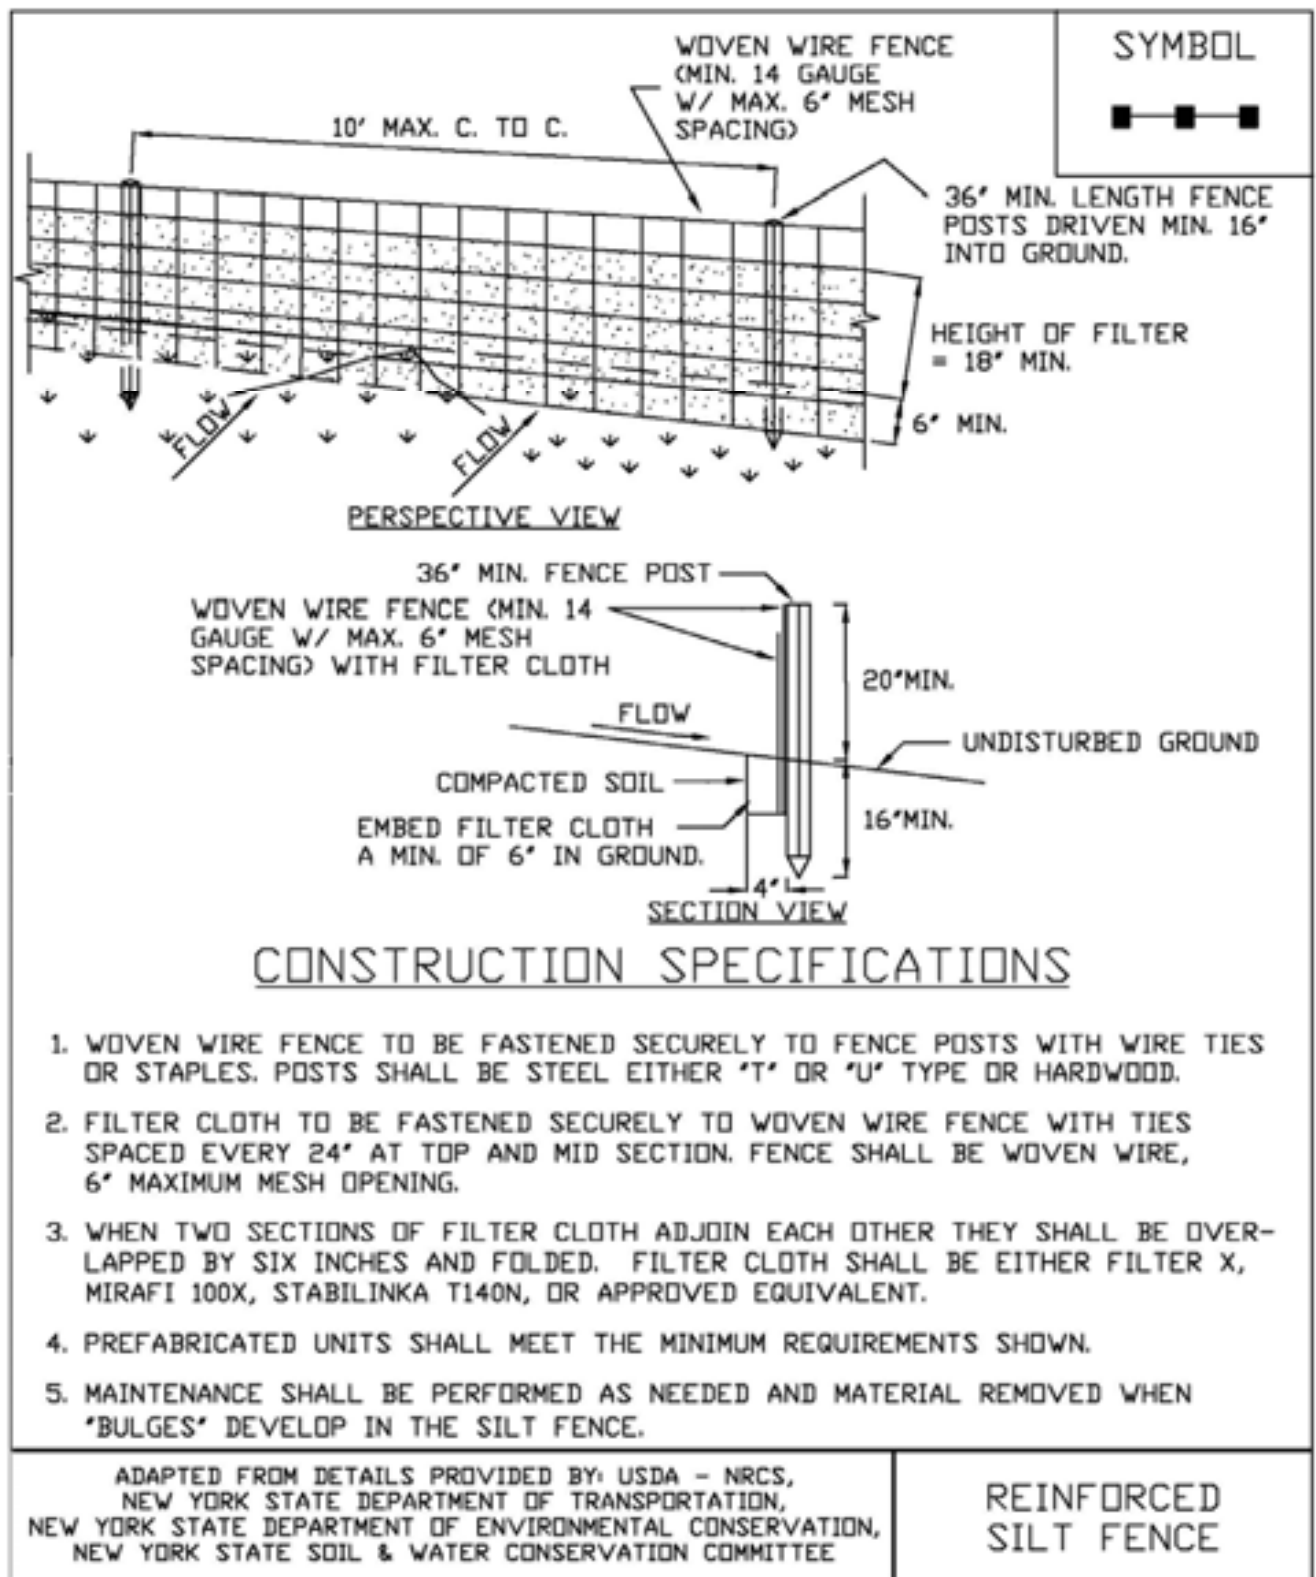

STANDARD AND SPECIFICATIONS FOR STORM DRAIN INLET PROTECTION



Definition & Scope

A **temporary** barrier with low permeability, installed around inlets in the form of a fence, berm or excavation around an opening, detaining water and thereby reducing the sediment content of sediment laden water by settling thus preventing heavily sediment laden water from entering a storm drain system.

Conditions Where Practice Applies

This practice shall be used where the drainage area to an inlet is disturbed, it is not possible to temporarily divert the storm drain outfall into a trapping device, and watertight blocking of inlets is not advisable. **It is not to be used in place of sediment trapping devices.** This practice shall be used with an upstream buffer strip if placed at a storm drain inlet on a paved surface. It may be used in conjunction with storm drain diversion to help prevent siltation of pipes installed with low slope angle.

Types of Storm Drain Inlet Practices

There are five (5) specific types of storm drain inlet protection practices that vary according to their function, location, drainage area, and availability of materials:

- I. Excavated Drop Inlet Protection
- II. Fabric Drop Inlet Protection
- III. Stone & Block Drop Inlet Protection
- IV. Paved Surface Inlet Protection
- V. Manufactured Insert Inlet Protection

Design Criteria

Drainage Area – The drainage area for storm drain inlets shall not exceed one acre. Erosion control/temporary stabilization measures must be implemented on the disturbed

drainage area tributary to the inlet. The crest elevations of these practices shall provide storage and minimize bypass flow.

Type I – Excavated Drop Inlet Protection

This practice is generally used during initial overlot grading after the storm drain trunk line is installed.

Limit the drainage area to the inlet device to 1 acre. Excavated side slopes shall be no steeper than 2:1. The minimum depth shall be 1 foot and the maximum depth 2 feet as measured from the crest of the inlet structure. Shape the excavated basin to fit conditions with the longest dimension oriented toward the longest inflow area to provide maximum trap efficiency. The capacity of the excavated basin should be established to contain 900 cubic feet per acre of disturbed area. Weep holes, protected by fabric and stone, should be provided for draining the temporary pool.

Inspect and clean the excavated basin after every storm. Sediment should be removed when 50 percent of the storage volume is achieved. This material should be incorporated into the site in a stabilized manner.

Type II – Fabric Drop Inlet Protection



This practice is generally used during final elevation grading phases after the storm drain system is completed.

Limit the drainage area to 1 acre per inlet device. Land area slope immediately surrounding this device should not exceed 1 percent. The maximum height of the fabric above the inlet crest shall not exceed 1.5 feet unless reinforced.

The top of the barrier should be maintained to allow overflow to drop into the drop inlet and not bypass the inlet to

unprotected lower areas. Support stakes for fabric shall be a minimum of 3 feet long, spaced a maximum 3 feet apart. They should be driven close to the inlet so any overflow drops into the inlet and not on the unprotected soil. Improved performance and sediment storage volume can be obtained by excavating the area.

Inspect the fabric barrier after each rain event and make repairs as needed. Remove sediment from the pool area as necessary with care not to undercut or damage the filter fabric. Upon stabilization of the drainage area, remove all materials and unstable sediment and dispose of properly. Bring the adjacent area of the drop inlet to grade, smooth and compact and stabilize in the appropriate manner to the site.

Type III – Stone and Block Drop Inlet Protection

This practice is generally used during the initial and intermediate overlot grading of a construction site.

Limit the drainage area to 1 acre at the drop inlet. The stone barrier should have a minimum height of 1 foot and a maximum height of 2 feet. Do not use mortar. The height should be limited to prevent excess ponding and bypass flow.

Recess the first course of blocks at least 2 inches below the crest opening of the storm drain for lateral support. Subsequent courses can be supported laterally if needed by placing a 2x4 inch wood stud through the block openings perpendicular to the course. The bottom row should have a few blocks oriented so flow can drain through the block to dewater the basin area.

The stone should be placed just below the top of the blocks on slopes of 2:1 or flatter. Place hardware cloth of wire mesh with ½ inch openings over all block openings to hold stone in place.

As an optional design, the concrete blocks may be omitted and the entire structure constructed of stone, ringing the outlet (“doughnut”). The stone should be kept at a 3:1 slope toward the inlet to keep it from being washed into the inlet. A level area 1 foot wide and four inches below the crest will further prevent wash. Stone on the slope toward the inlet should be at least 3 inches in size for stability and 1 inch or smaller away from the inlet to control flow rate. The elevation of the top of the stone crest must be maintained 6 inches lower than the ground elevation down slope from the inlet to ensure that all storm flows pass over the stone into the storm drain and not past the structure. Temporary diking should be used as necessary to prevent bypass flow.

The barrier should be inspected after each rain event and repairs made where needed. Remove sediment as necessary to provide for accurate storage volume for subsequent rains. Upon stabilization of contributing drainage area, remove all

materials and any unstable soil and dispose of properly.

Bring the disturbed area to proper grade, smooth, compact and stabilize in a manner appropriate to the site.

Type IV – Paved Surface Inlet Protection



This practice is generally used after pavement construction has been done while final grading and soil stabilization is occurring. These practices should be used with upstream buffer strips in linear construction applications, and with temporary surface stabilization for overlot areas, to reduce the sediment load at the practice. This practice includes sand bags, compost filter socks, geo-tubes filled with ballast, and manufactured surface barriers. Pea gravel can also be used in conjunction with these practices to improve performance. When the inlet is not at a low point, and is offset from the pavement or gutter line, protection should be selected and installed so that flows are not diverted around the inlet.



The drainage area should be limited to 1 acre at the drain inlet. All practices will be placed at the inlet perimeter or beyond to maximize the flow capacity of the inlet. Practices shall be weighted, braced, tied, or otherwise anchored to prevent movement or shifting of location on paved surfaces. Traffic safety shall be integrated with the use of this practice. All practices should be marked with traffic safety cones as appropriate. Structure height shall not cause flooding or by-pass flow that would cause additional erosion.

The structure should be inspected after every storm event. Any sediment should be removed and disposed of on the site. Any broken or damaged components should be replaced. Check all materials for proper anchorage and secure as necessary.

Type V - Manufactured Insert Inlet Protection



The drainage area shall be limited to 1 acre at the drain inlet. All inserts will be installed and anchored in accordance with the manufacturers recommendations and design details. The fabric portion of the structure will equal or exceed the performance standard for the silt fence fabric. The inserts will be installed to preserve a minimum of 50 percent of the open, unobstructed design flow area of the storm drain inlet opening to maintain capacity for storm events.

STANDARD AND SPECIFICATIONS FOR STRAW BALE DIKE



quarter of an acre per 100 feet of dike and the length of slope above the dike shall be less than 100 feet.

Design Criteria

The above table is adequate, in general, for a one-inch rain-fall event. Larger storms could cause failure of this practice. Use of this practice in sensitive areas for longer than one month should be specifically designed to store expected runoff. All bales shall be placed on the contour with cut edge of bale adhering to the ground. See Figure 5.34 on page 5.64 for details.

Definition & Scope

A **temporary** barrier of straw, or similar material, used to intercept sediment laden runoff from small drainage areas of disturbed soil to reduce runoff velocity and effect deposition of the transported sediment load. Straw bale dikes have an estimated design life of three (3) months.

Condition Where Practice Applies

The straw bale dike is used where:

1. No other practice is feasible.
2. There is no concentration of water in a channel or other drainageway above the barrier.
3. Erosion would occur in the form of sheet erosion.
4. Length of slope above the straw bale dike does not exceed the following limits with the bale placed 10 feet from the toe of the slope:

Constructed Slope	Percent Slope	Slope Length (ft.)
2:1	50	25
3:1	33	50
4:1	25	75

Where slope gradient changes through the drainage area, steepness refers to the steepest slope section contributing to the straw bale dike.

The practice may also be used for a single family lot if the slope is less than 15 percent. The contributing drainage areas in this instance shall be less than one

Figure 5.34
Straw Bale Dike

